


CIRCUIT DRAWN WITH  
POWER SUPPLY OFF

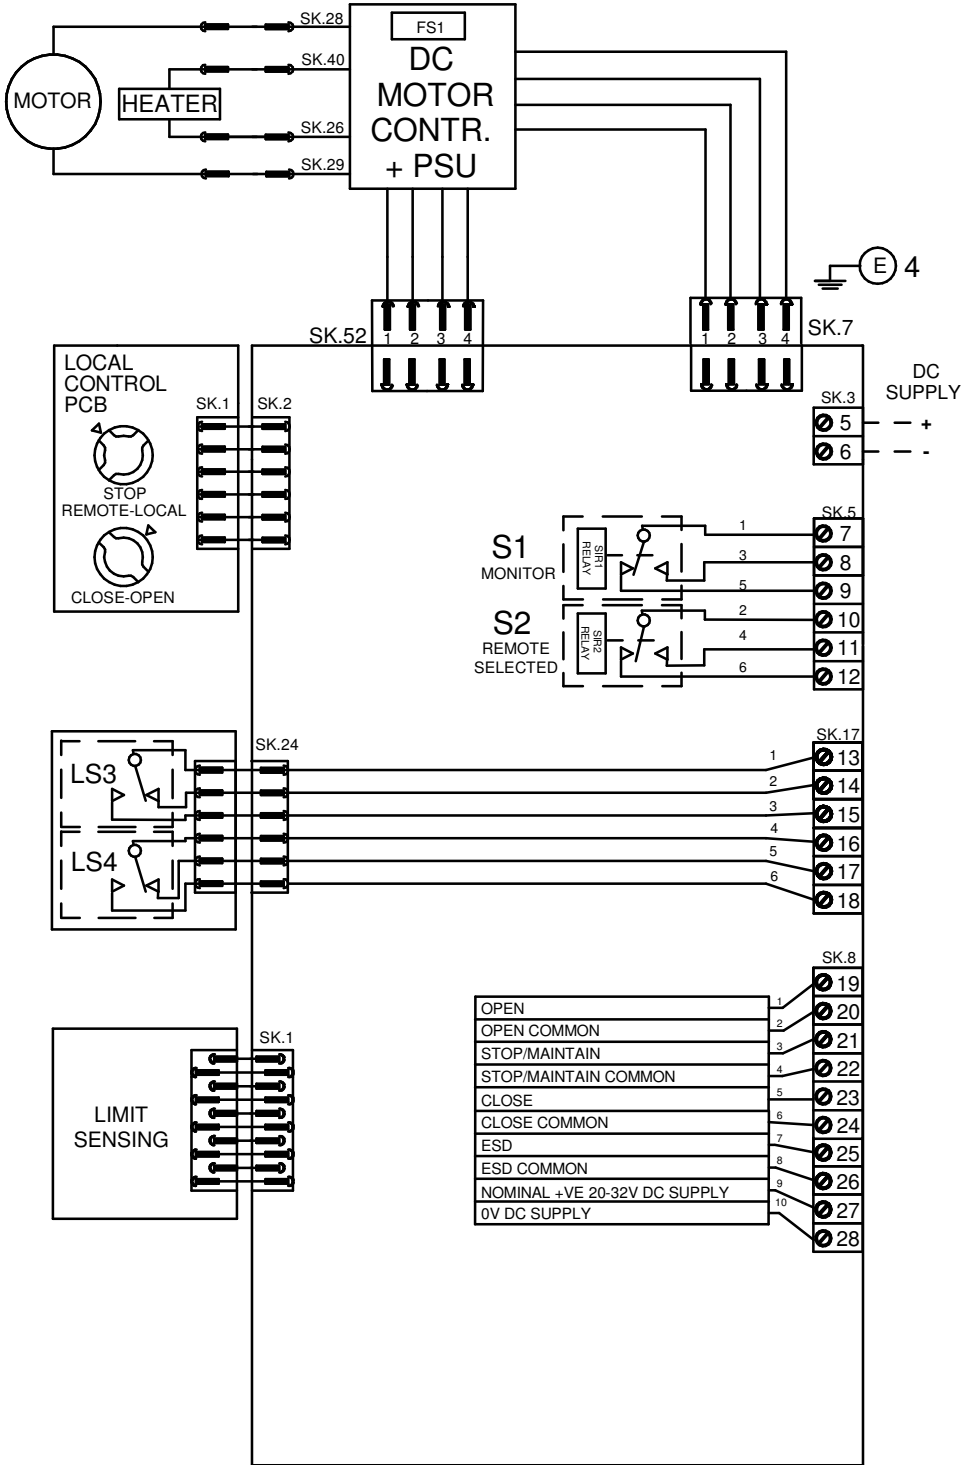

FS1 - See ROMPAK PUB008-006 Installation and Maintenance Manual

NOTE

FOR TYPICAL REMOTE CONTROL INDICATING, MONITORING AND ALARM CIRCUITS SEE PUBLICATION DOC862

MAX EXTERNAL LOAD ON SIR RELAYS TO BE 5A. MAX VOLTAGE 120V AC/DC

CONTROL SIGNAL THRESHOLD VOLTAGES:  
MAX 60V DC  
TO BE MINIMUM 'ON' 14V DC AT 1mA  
MAXIMUM 'OFF' = 3V  
MINIMUM CONTROL SIGNAL DURATION TO BE 300mS.

CURRENT DRAWN FROM EACH REMOTE CONTROL SIGNAL IS 5mA ON 24V DC

LS3 / LS4  
MAXIMUM CURRENT 3A MAXIMUM  
VOLTAGE 120V AC/DC

ACTUATOR CONFIGURATION  
VIA DIL SWITCH SW2

REFER TO INSTALLATION INSTRUCTIONS FOR DIL SWITCH SELECTION

Iss	Date	Chkd	Revision Details
3	250414	JJ	Drawing layout and text change
4	290719	JJ	Delete SK.10

[www.rotork.com](http://www.rotork.com)

ROTORK CONTROLS LTD  
BATH, BA1 3JQ  
ENGLAND  
Tel:01225-733200

ROTORK CONTROLS INC  
ROCHESTER  
NY 14624, USA  
Tel:585-247-2304

ROMPAK DC - NO TORQUE SWITCHES

Drawn by: VYA  
Date : 25-Apr-14  
Base WD: R202-000  
Job No : - -  
MI No : - -

Circuit Diagram No	Issue No
<b>R202-000</b>	<b>4</b>