



CIRCUIT DRAWN WITH
POWER SUPPLY OFF

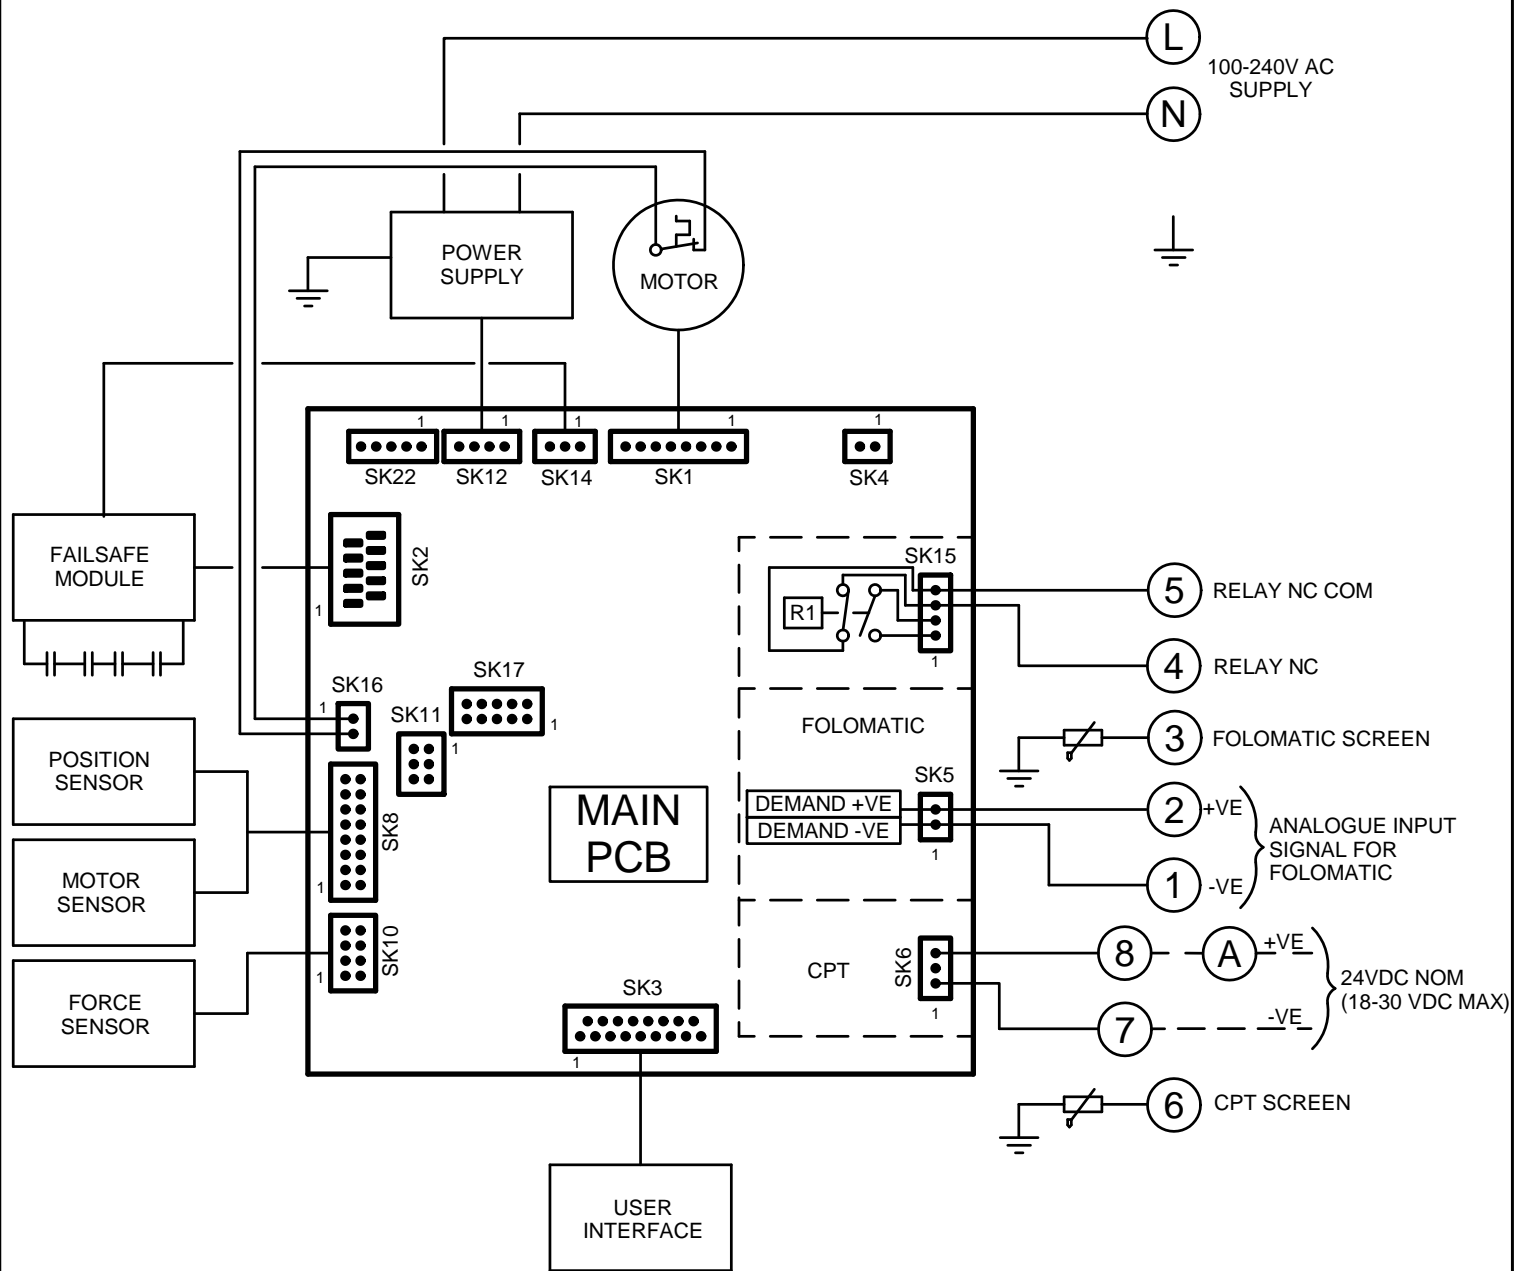

WHEN MANUAL
OVERRIDE IS FITTED
MOTOR DISABLE
SWITCH FITTED IN
SERIES WITH
THERMOSTAT (SK16)

RELAY R1 CAN BE CONFIGURED TO
INDICATE ANY ONE OF THE FOLLOWING:-

- 0 DISABLED
- 1 REMOTE CONTROL AVAILABLE
- 2 FAULT
- 3 FULLY OPEN
- 4 FULLY CLOSED
- 5 FORCE TRIP OPENING
- 6 FORCE TRIP CLOSING
- 7 FORCE TRIP ANY POSITION
- 8 FAILSAFE OPERATION

Iss	Date	Chkd	Revision Details
3	190312 PMJ	PJW	NOTES ADDED + SK22.
2	290909 BJS	AGM	Voltage source added for CPT.
1	081008 DA	SM	First Issue.

www.rotork.com

ROTORK CONTROLS LTD
BATH, BA1 3JQ
ENGLAND
Tel:01225-733200

ROTORK CONTROLS INC
ROCHESTER
NY 14624, USA
Tel:585-247-2304

CVA, A/C SUPPLY, N/C CONTACT &
FAILSAFE.

Drawn by: D.Adams
Date : 081008
Base WD: C21-00
Job No : --
MI No : --

Circuit Diagram No	Issue No
C21-00	3