

NOTES:


1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT
1 OF 2

A

M10-F0

REV
C

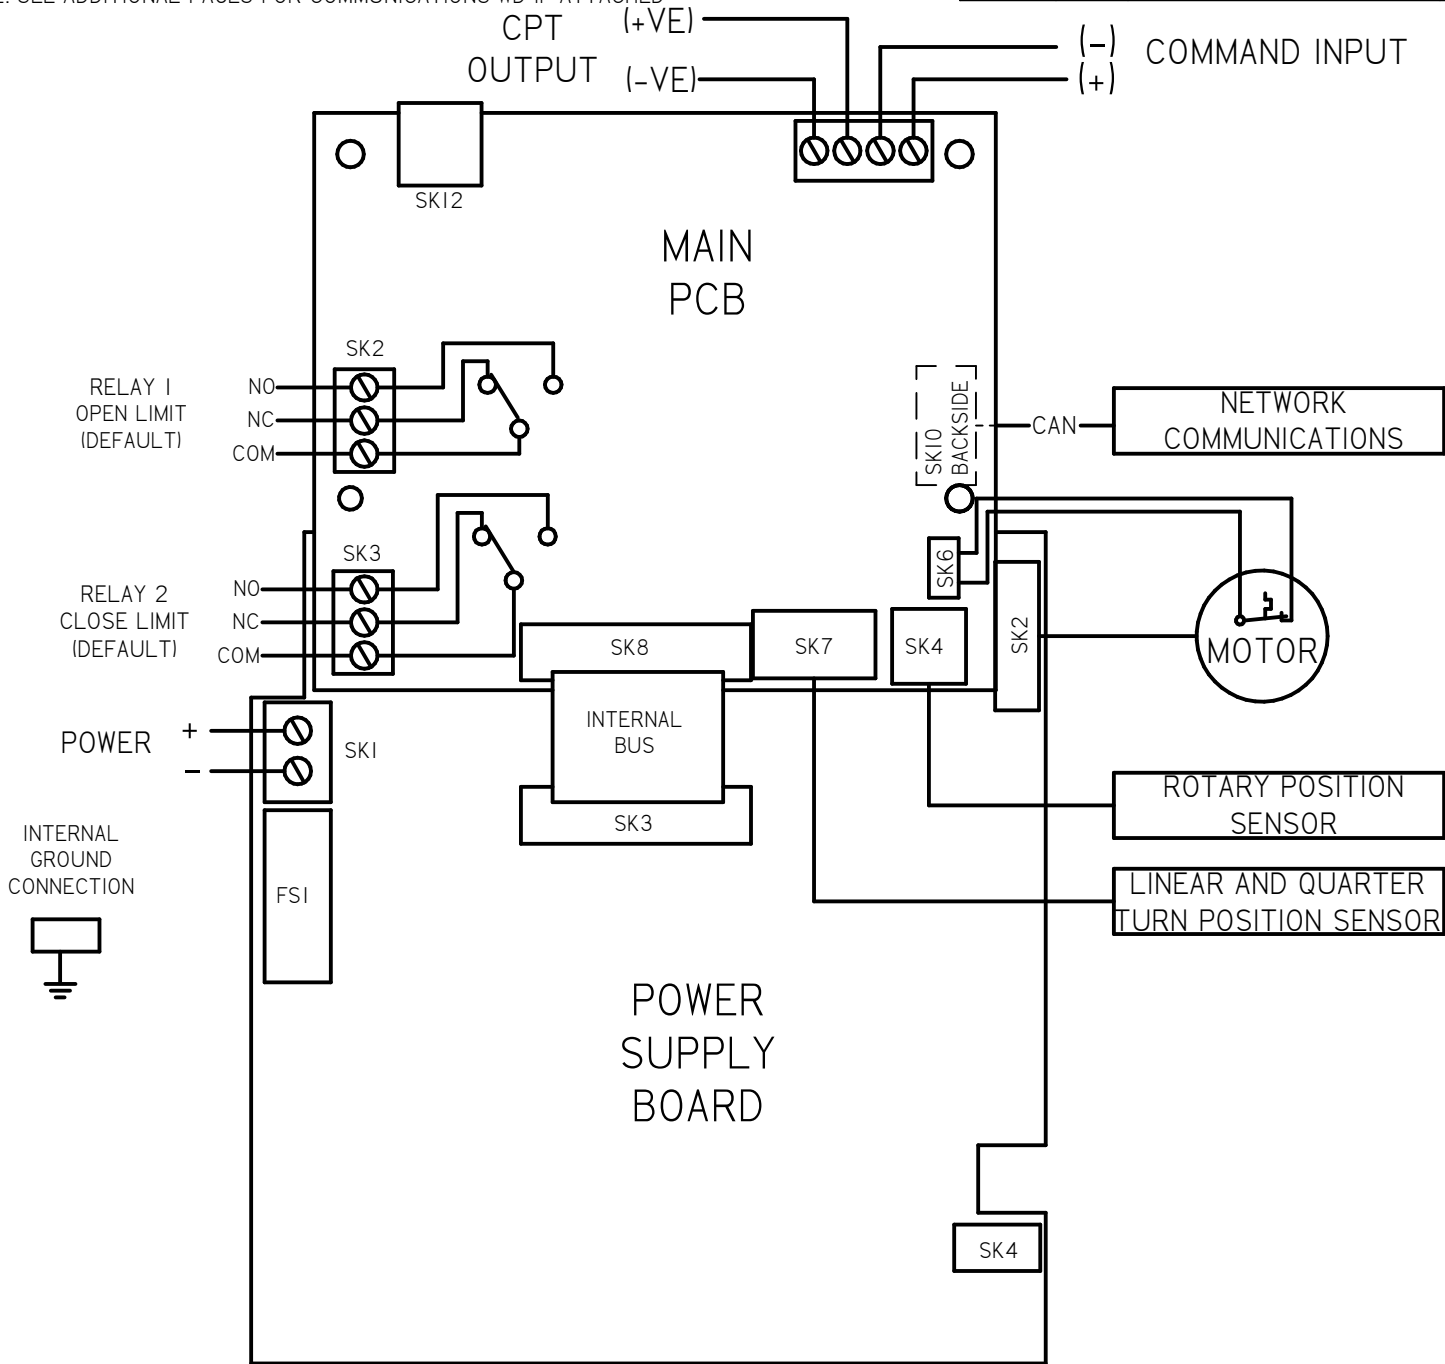


B	ECR 17920. UPDATED TITLE & CALLOUTS	GVM 3-8-13
C	ECR 18062. UPDATE PSB: SK1 CONNECTOR	GVM 11-4-14
REV	DESCRIPTION	DATE

<p>TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°</p>		
<p>SCALE: NTS</p>		
<p>DRAWN: GVM</p>	<p>PROD. DV.</p>	<p>PROD. ENG. CHK</p>
<p>DATE: 2-8-13</p>	<p>DATE:</p>	<p>DATE: 2-8-13</p>


rotork[®]
Process Controls
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

<p>TITLE : CMA WIRING DIAGRAM</p>		
<p>FOR : DC POWER OPERATION FOUNDATION FIELDBUS TERMINAL CONNECTIONS</p>		
<p>SHT 1 OF 2</p>	<p>A</p>	<p>M10-F0</p>

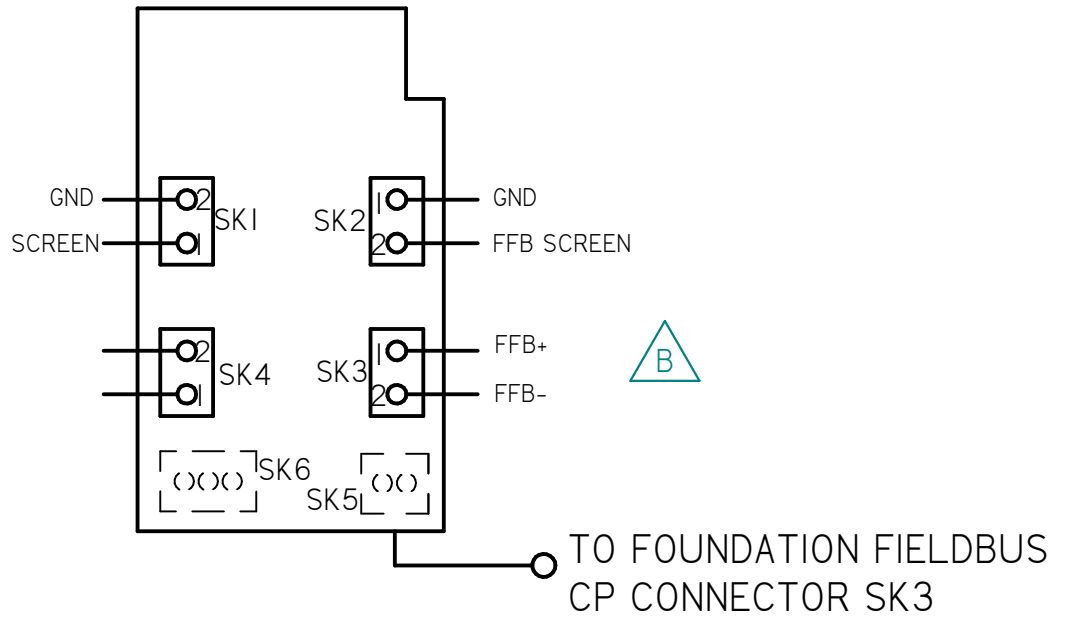

FOUNDATION FIELDBUS TERMINAL BOARD

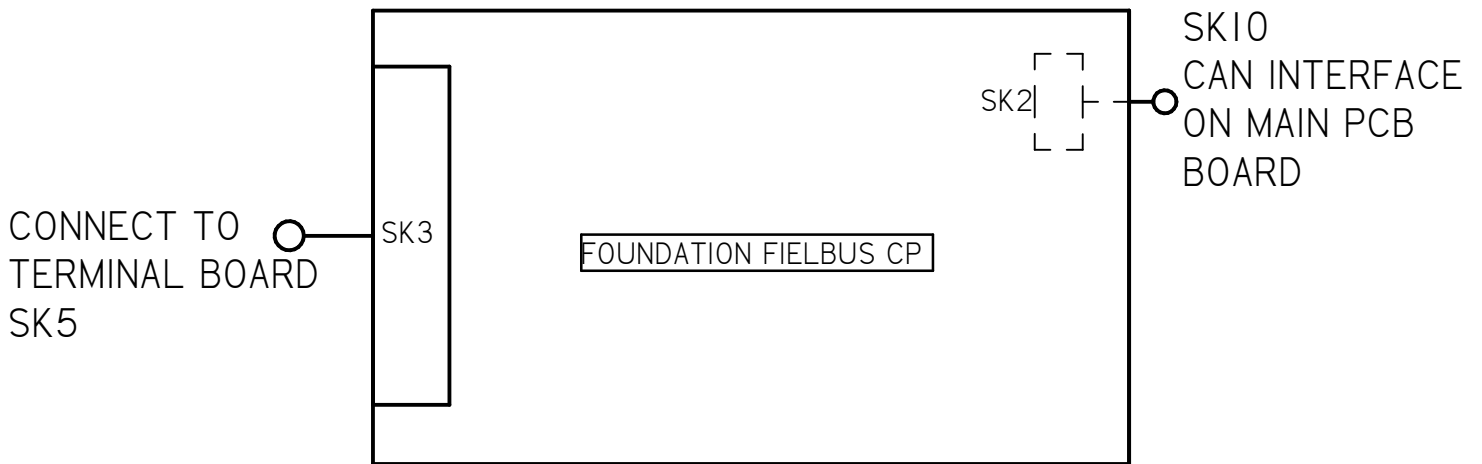

B	ECR 17920. UPDATED TITLE & CALLOUTS	GVM 3-8-13
C	ECR 18062. UPDATE PSB: SK1 CONNECTOR	GVM 11-4-14
REV	DESCRIPTION	DATE

<p>TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°</p>		
<p>SCALE: NTS</p>		
DRAWN: GVM	PROD. DV.	PROD. ENG. CHK
DATE: 2-8-13	DATE:	DATE: 2-8-13

rotork[®]
Process Controls
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

<p>TITLE : CMA WIRING DIAGRAM</p>		
<p>FOR : DC POWER OPERATION FOUNDATION FIELDBUS TERMINAL CONNECTIONS</p>		
SHT 2 OF 2	A	M10-F0