

NOTES:

1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT
1 OF 3

A


M01-F0

REV
A

SKI INTERFACE ON HMI INTERFACE BOARD

CPT (+VE) OUTPUT (-VE)

(-) COMMAND INPUT (+)

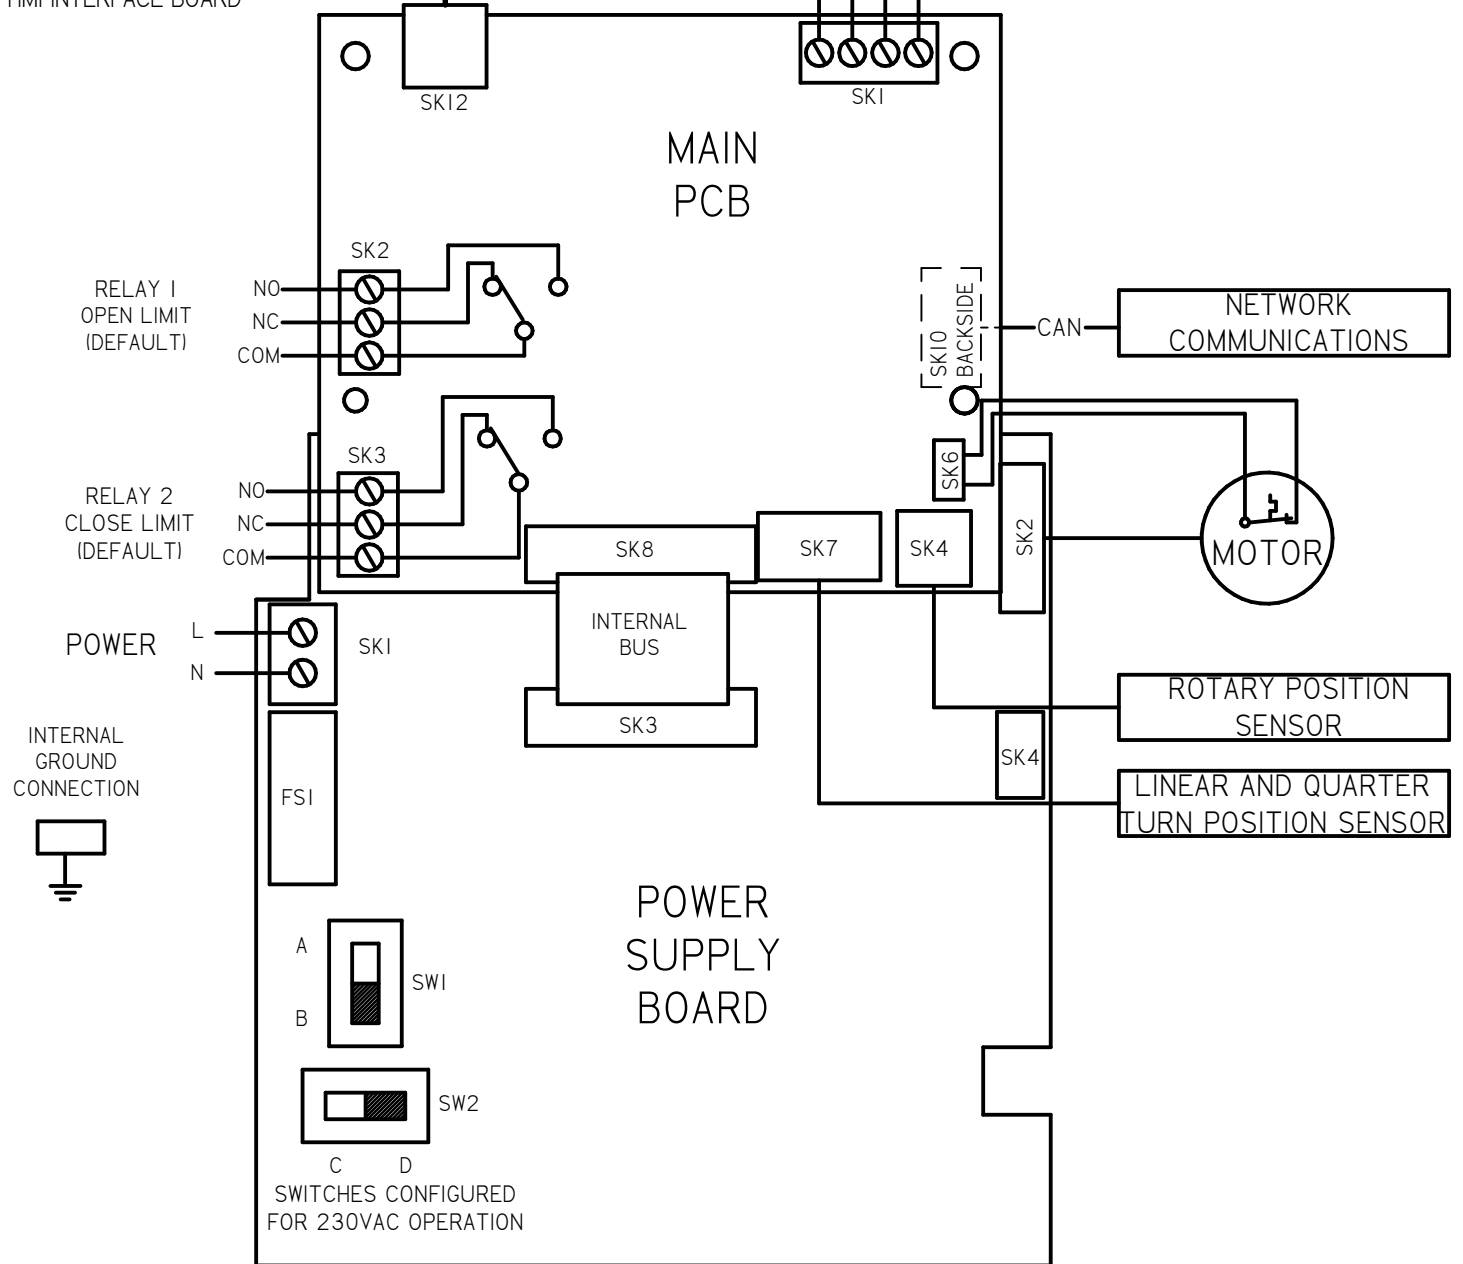

| INPUT VOLTAGE | SW1 | SW2 |
|---------------|-----|-----|
| 110 VAC | A | C |
| 115 VAC | A | D |
| 208 VAC | B | C |
| 230 VAC | B | D |

| REV | DESCRIPTION | DATE |
|-----|-----------------|----------------|
| A | INITIAL RELEASE | GVM 1-12-15 |

| | | |
|--|------------------|-------------------|
| <p>TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°</p> | | |
| <p>SCALE: NTS</p> | | |
| <p>DRAWN: GVM</p> | <p>PROD. DV.</p> | <p>PROD. ENG.</p> |
| <p>DATE: 1-12-15</p> | <p>DATE:</p> | <p>DATE:</p> |

rotork
Process Controls
MILWAUKEE, WISCONSIN, USA


This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.



| | | |
|--|-----------------|----------------------|
| <p>TITLE : CMA WIRING DIAGRAM</p> | | |
| <p>FOR : AC POWER OPERATION LOCAL CONTROLS, FOUNDATION FIELDBUS TERMINAL CONNECTIONS</p> | | |
| <p>SHT 1 OF 3</p> | <p>A</p> | <p>M01-F0</p> |


HMI INTERFACE BOARD



SKI2 INTERFACE ON
MAIN PCB BOARD

| | | | | | |
|--|-----------------|------------|---|----------|---------------------------------------|
| | | | | | |
| A | INITIAL RELEASE | GVM | 1-12-15 | | |
| REV | DESCRIPTION | DATE | | | |
| <p>TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°</p> | | |  <p>MILWAUKEE, WISCONSIN, USA</p> | | <p>TITLE : CMA WIRING DIAGRAM</p> |
| <p>SCALE: NTS</p> | | | <p>FOR : AC POWER OPERATION LOCAL CONTROLS, FOUNDATION FIELDBUS TERMINAL CONNECTIONS</p> | | |
| DRAWN: | PROD. DV. | PROD. ENG. | <p>This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.</p> | | |
| GVM | | | | | |
| DATE: | DATE: | DATE: | | | |
| 1-12-15 | | | | | |
| | | | SHT 2 OF 3 | A | M01-F0 |

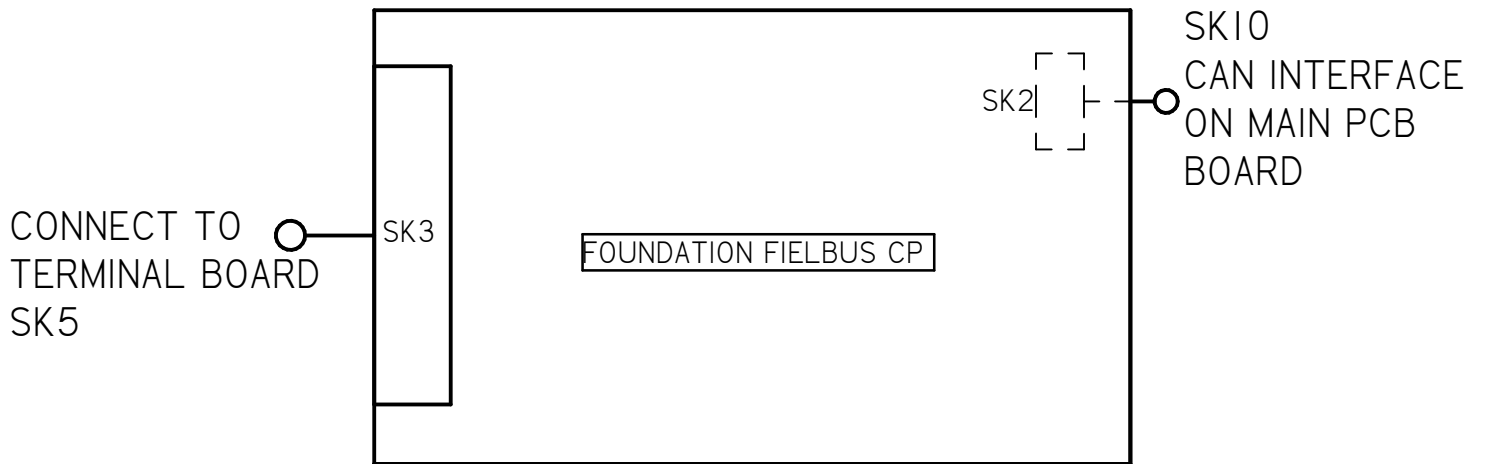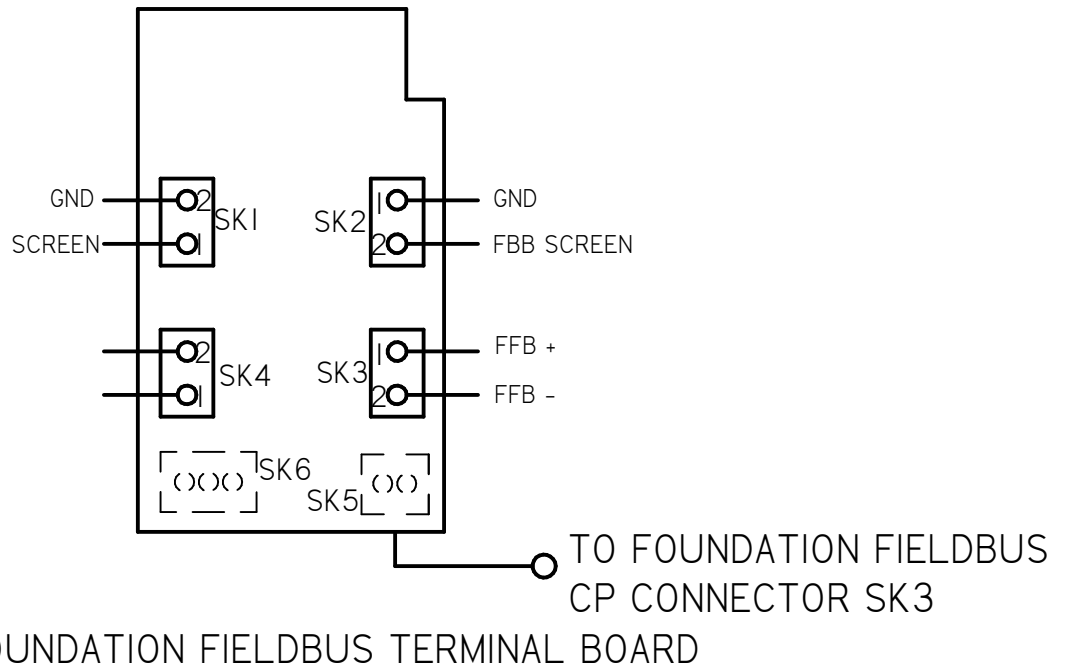

| | | | | | |
|---|-----------------|------------|--|--|--|
| | | | | | |
| A | INITIAL RELEASE | GVM | 1-12-15 | | |
| REV | DESCRIPTION | DATE | | | |
| TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1° | | |  MILWAUKEE, WISCONSIN, USA | | TITLE : CMA WIRING DIAGRAM |
| SCALE: NTS | | | | | FOR : AC POWER OPERATION LOCAL CONTROLS, FOUNDATION FIELDBUS TERMINAL CONNECTIONS |
| DRAWN: GVM | PROD. DV. | PROD. ENG. | This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved. | | SHT 3 OF 3 A M01-F0 |
| DATE: 1-12-15 | DATE: | DATE: | | | |