

NOTES:

1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT
1 OF 3

A


M01-H0

REV
A

SKI INTERFACE ON HMI INTERFACE BOARD

CPT (+VE) OUTPUT (-VE)

(-) COMMAND INPUT (+)

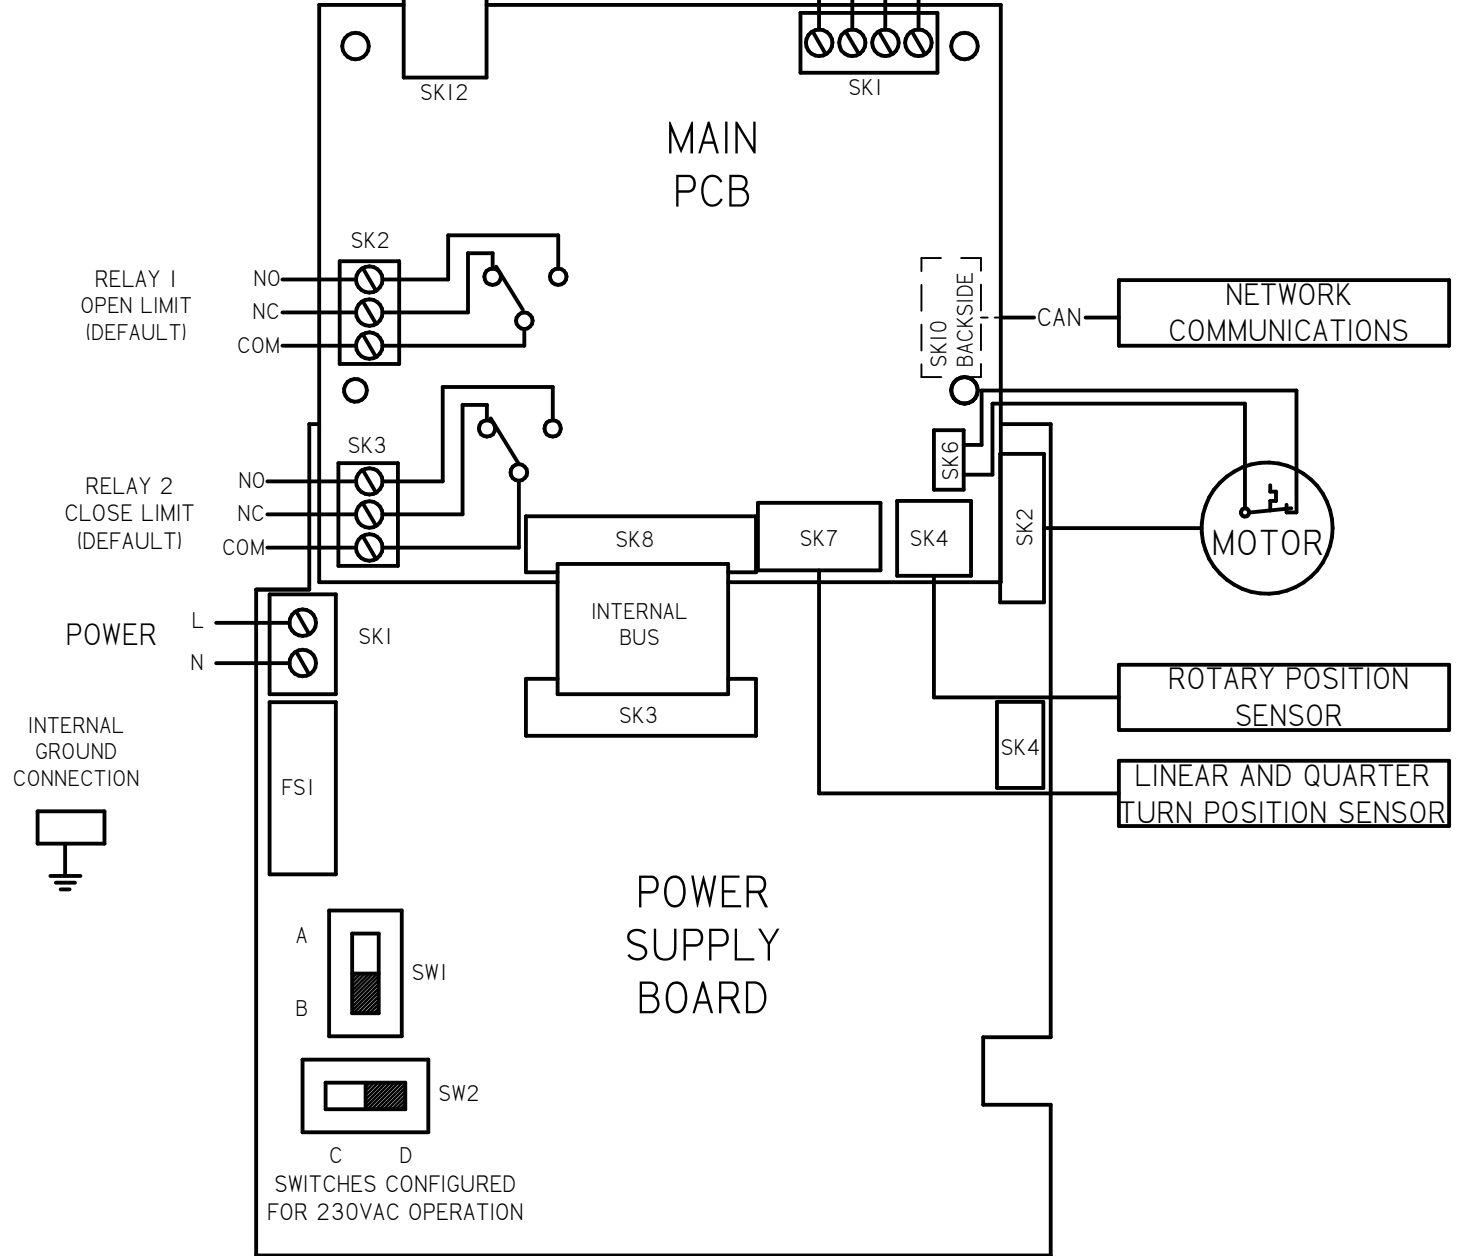

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D

A	INITIAL RELEASE	GVM 1-12-15
REV	DESCRIPTION	DATE

TOLERANCES
UNLESS OTHERWISE SPECIFIED
.XX = ±.02 XXX = ±.005 ANGULAR ±1°

SCALE: **NTS**

DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 1-12-15	DATE:	DATE:

rotork
Process Controls
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE :
CMA WIRING DIAGRAM


FOR :
AC POWER OPERATION
LOCAL CONTROLS, HART TERMINAL CONNECTIONS


SHT 1 OF 3	A	M01-H0
---------------	----------	---------------

HMI INTERFACE BOARD




SKI2 INTERFACE ON
MAIN PCB BOARD

A	INITIAL RELEASE	GVM	1-12-15		
REV	DESCRIPTION	DATE			
<p>TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°</p>			 MILWAUKEE, WISCONSIN, USA		<p>TITLE : CMA WIRING DIAGRAM</p>
<p>SCALE: NTS</p>					<p>FOR : AC POWER OPERATION LOCAL CONTROLS, HART TERMINAL CONNECTIONS</p>
DRAWN:	PROD. DV.	PROD. ENG.	<p>This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.</p>		<p>SHT 2 OF 3 A M01-H0</p>
DRAWN: GVM					
DATE:	DATE:	DATE:			
DATE: 1-12-15					

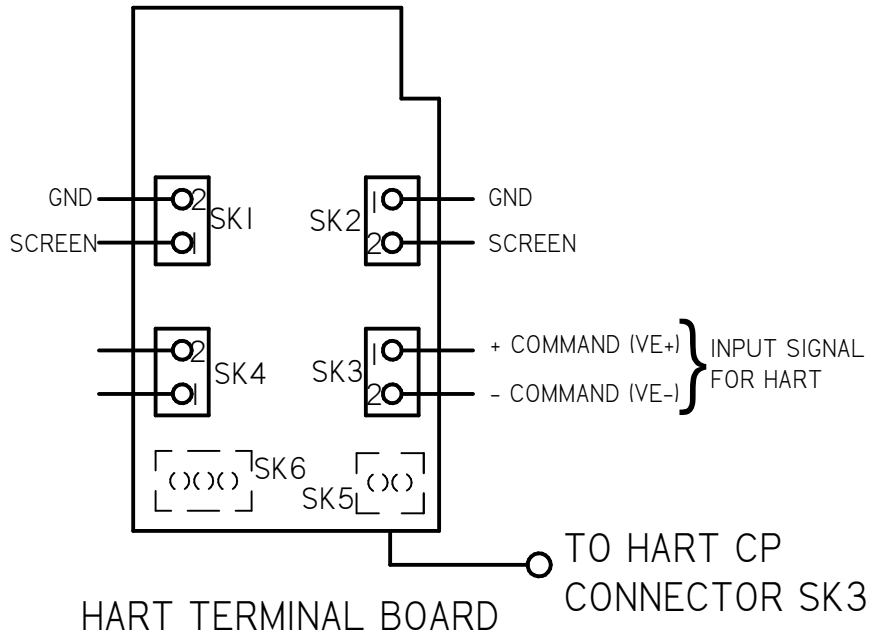

CONNECT TO
TERMINAL BOARD
SK5

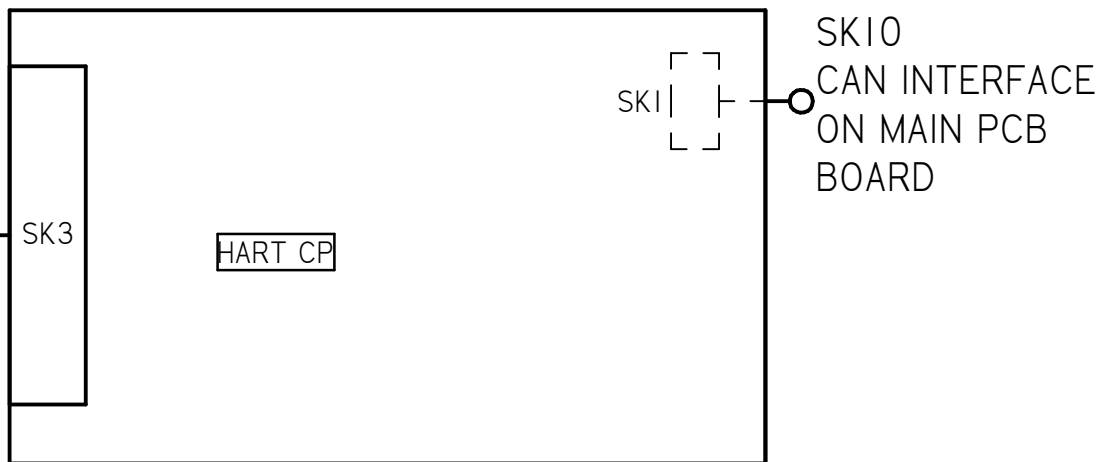

A	INITIAL RELEASE	GVM 1-12-15
REV	DESCRIPTION	DATE

TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°		
SCALE: NTS		
DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 1-12-15	DATE:	DATE:

rotork[®]
Process Controls
 MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : CMA WIRING DIAGRAM		
FOR : AC POWER OPERATION LOCAL CONTROLS, HART TERMINAL CONNECTIONS		
SHT 3 OF 3	A	M01-H0