

NOTES:

1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT
1 OF 3

A


M01-K0

REV
A

SK1 INTERFACE ON HMI INTERFACE BOARD

CPT (+VE) OUTPUT (-VE)

(-) COMMAND INPUT (+)

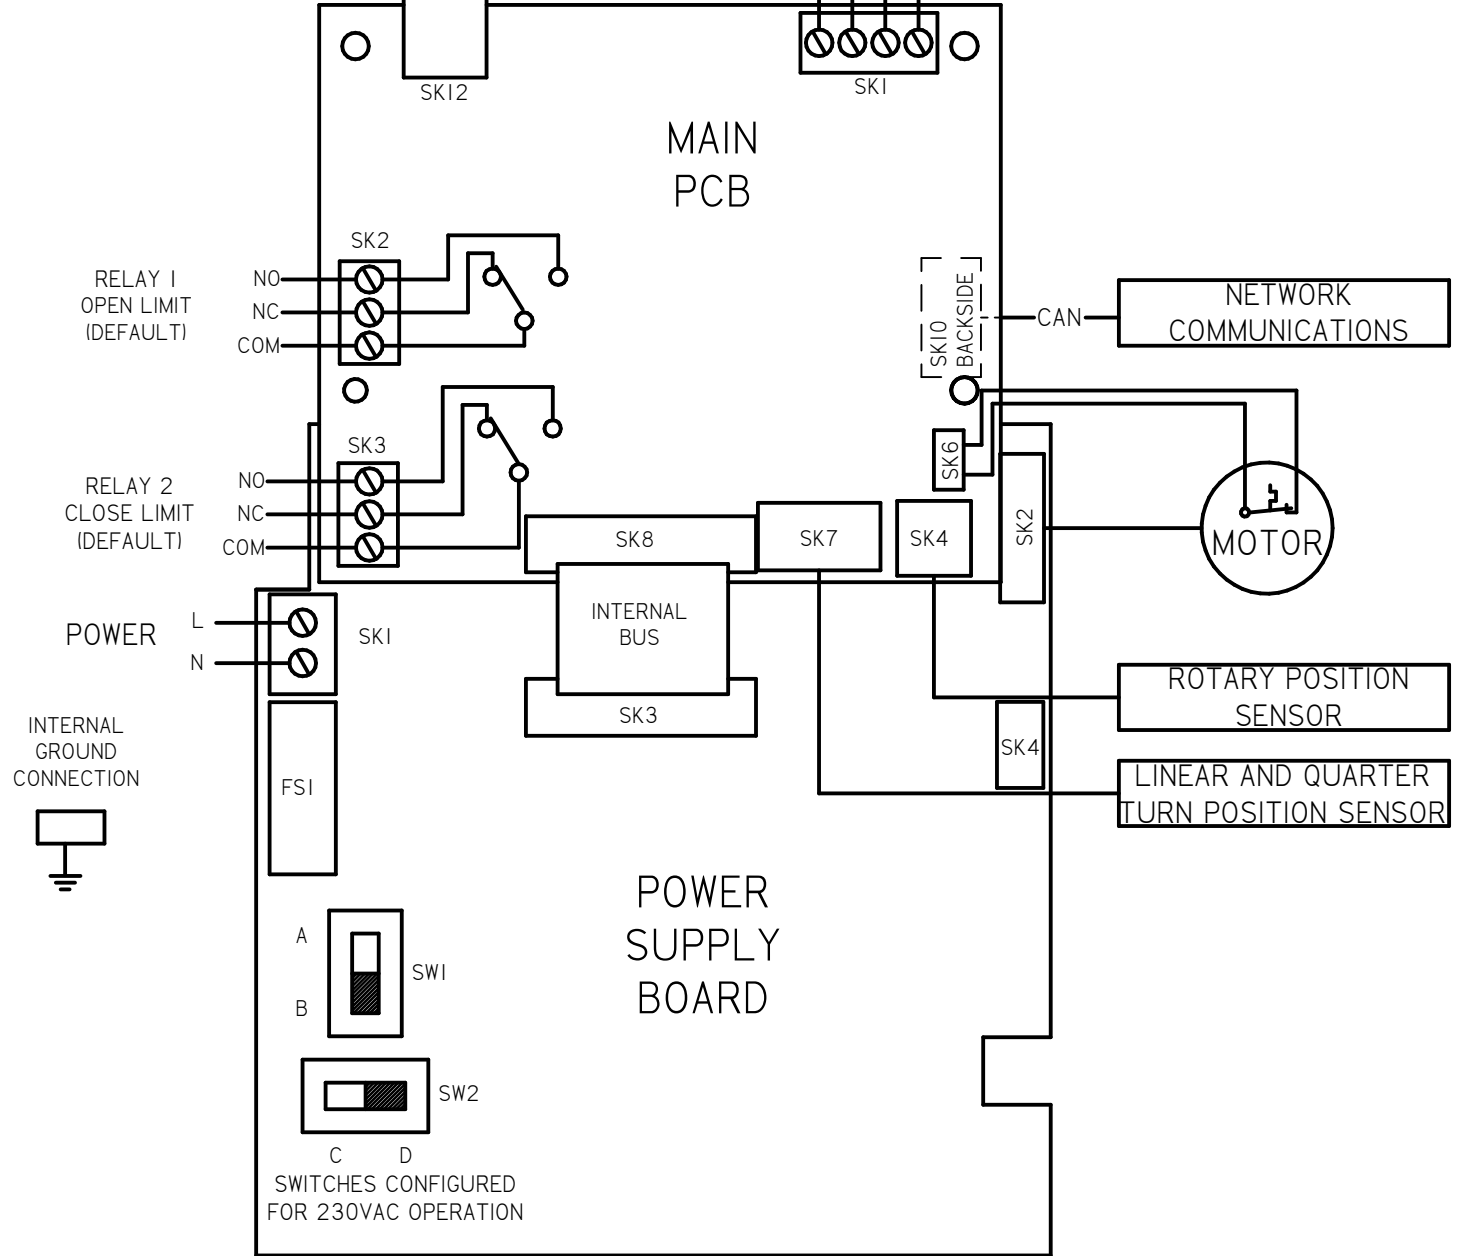

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D

A	INITIAL RELEASE	GVM 1-12-15
REV	DESCRIPTION	DATE


TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°		
SCALE: NTS		
DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 1-12-15	DATE:	DATE:

rotork[®]
Process Controls
MILWAUKEE, WISCONSIN, USA


This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.


TITLE : CMA WIRING DIAGRAM		
FOR : AC POWER OPERATION LOCAL CONTROLS, PAKSCAN TERMINAL CONNECTIONS		
SHT 1 OF 3	A	M01-K0

HMI INTERFACE BOARD

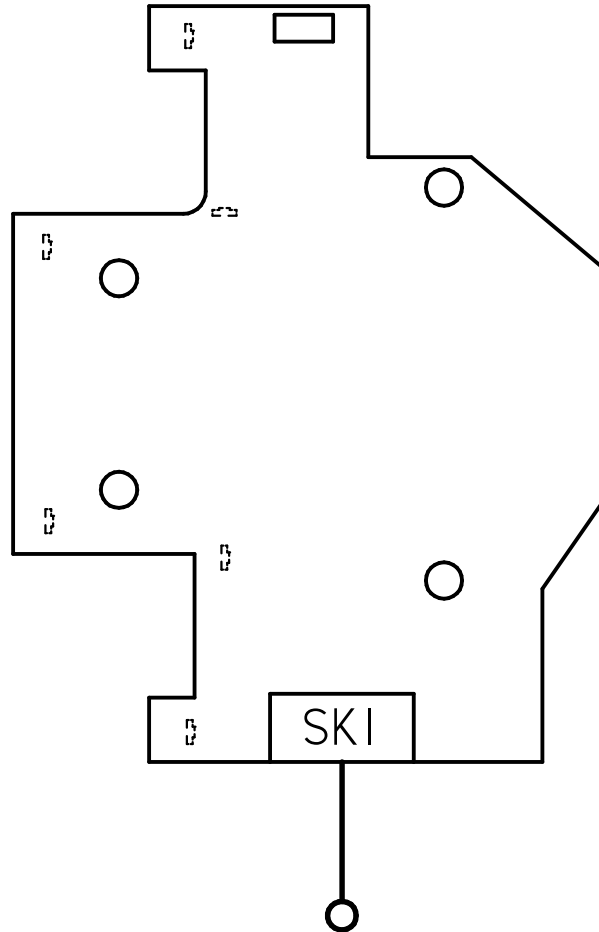


SKI2 INTERFACE ON
MAIN PCB BOARD


A	INITIAL RELEASE	GVM	1-12-15		
REV	DESCRIPTION	DATE			
TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°			 MILWAUKEE, WISCONSIN, USA		TITLE : CMA WIRING DIAGRAM
SCALE: NTS			FOR : AC POWER OPERATION LOCAL CONTROLS, PAKSCAN TERMINAL CONNECTIONS		
DRAWN: GVM	PROD. DV.	PROD. ENG.	This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.		SHT 2 OF 3 A M01-K0
DATE: 1-12-15	DATE:	DATE:			

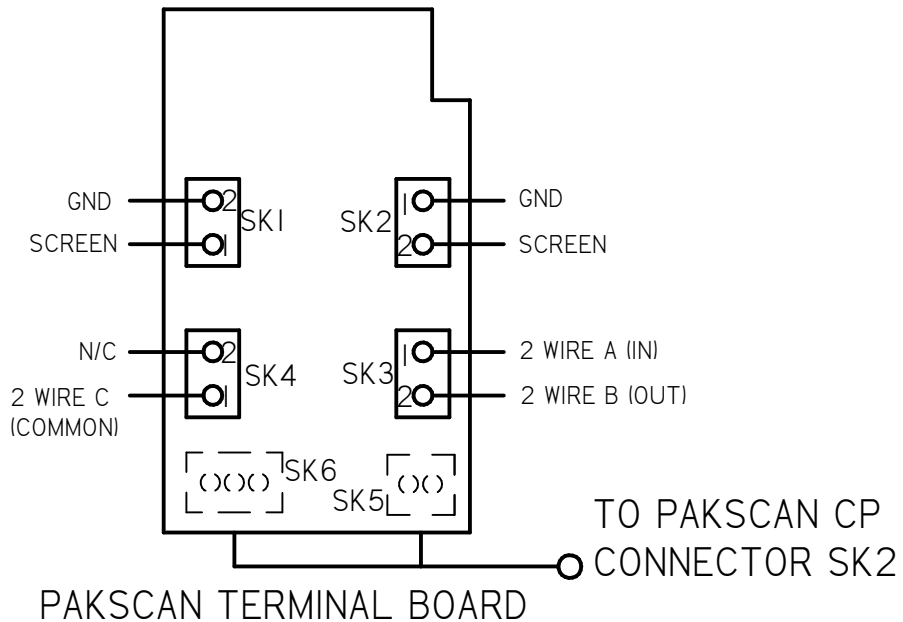

PAKSCAN TERMINAL BOARD

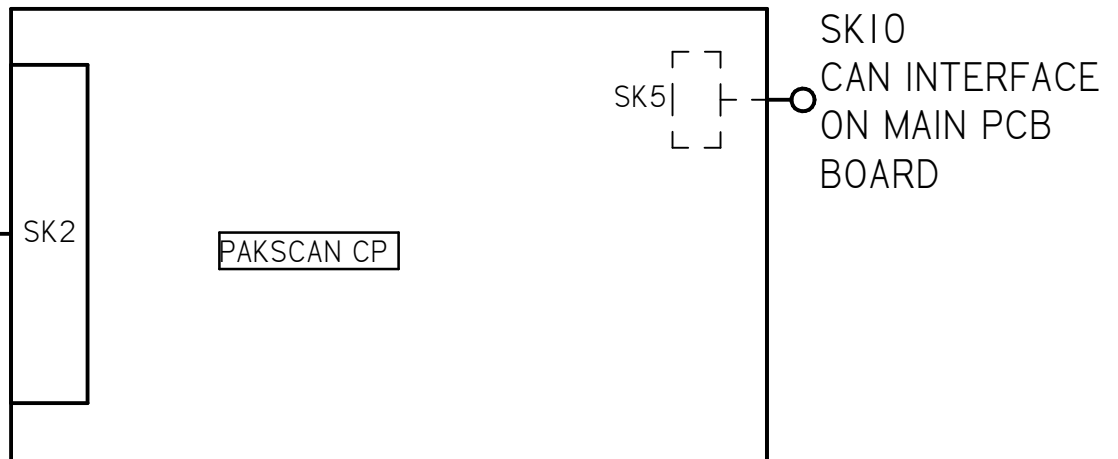

CONNECT TO
TERMINAL BOARD
SK5 & SK6

A	INITIAL RELEASE	GVM	1-12-15	TITLE : CMA WIRING DIAGRAM	
REV	DESCRIPTION	DATE		FOR : AC POWER OPERATION LOCAL CONTROLS, PAKSCAN TERMINAL CONNECTIONS	
TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°			 MILWAUKEE, WISCONSIN, USA		SHT 3 OF 3 A M01-K0
SCALE: NTS					
DRAWN: GVM	PROD. DV.	PROD. ENG.	This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.		
DATE: 1-12-15	DATE:	DATE:			