

NOTES:


1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT  
1 OF 3

**A**

M02-DS

REV  
**B**

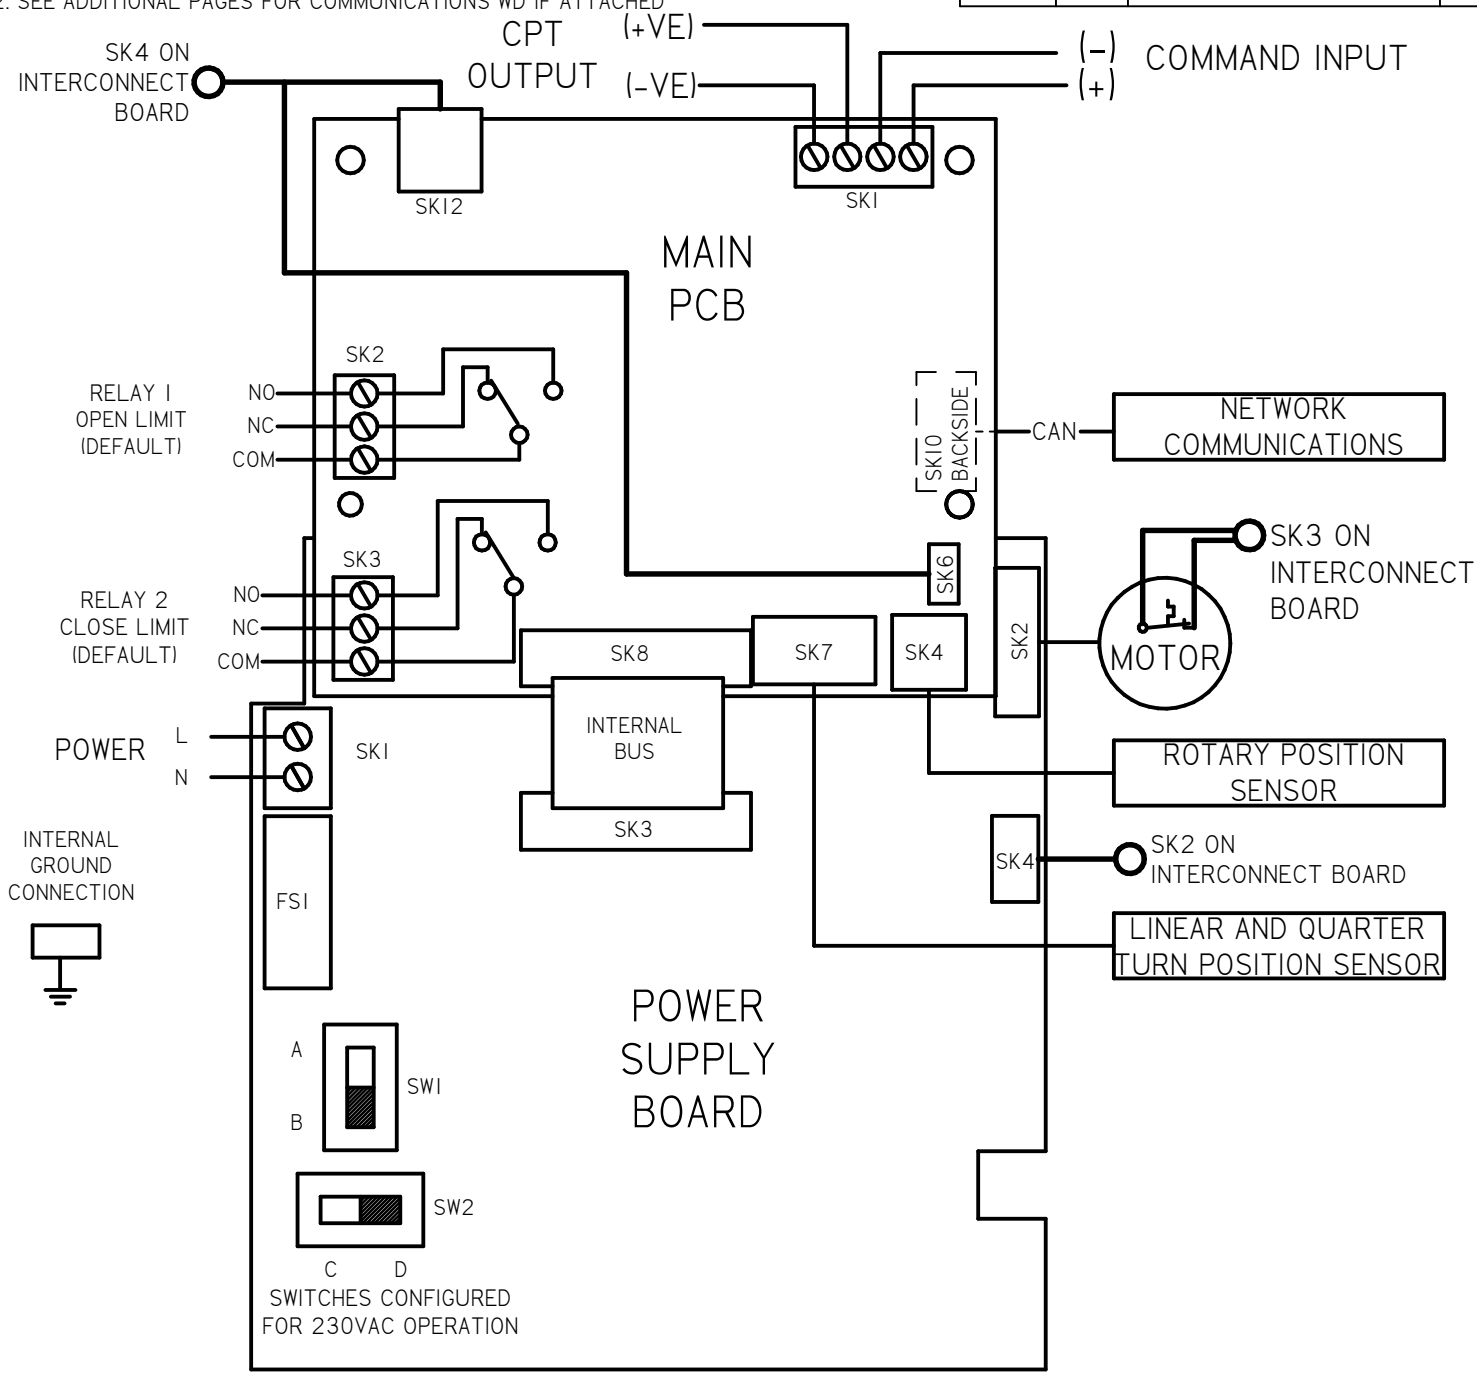

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D



<b>B</b>	ECR 18122 RIRO RENUMBER RELAYS	GVM 6/23/15
<b>A</b>	INITIAL RELEASE	GVM 1-12-15
<b>REV</b>	<b>DESCRIPTION</b>	<b>DATE</b>

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: <b>GVM</b>	PROD. DV.	PROD. ENG.
DATE: <b>1-12-15</b>	DATE:	DATE:


**rotork**  
Process Controls  
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.


TITLE : <b>CMA WIRING DIAGRAM</b>		
FOR : AC POWER OPERATION LOCAL CONTROLS AND UPS, RIRO TERMINAL CONNECTIONS		
SHT 1 OF 3	<b>A</b>	<b>M02-DS</b>

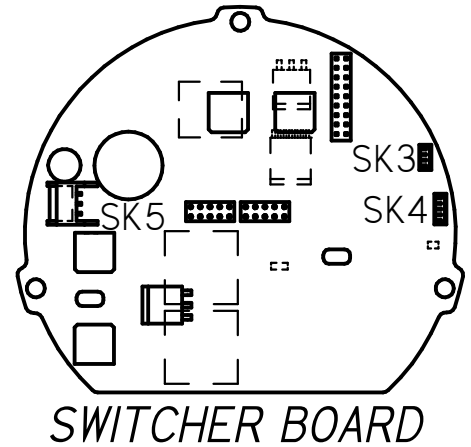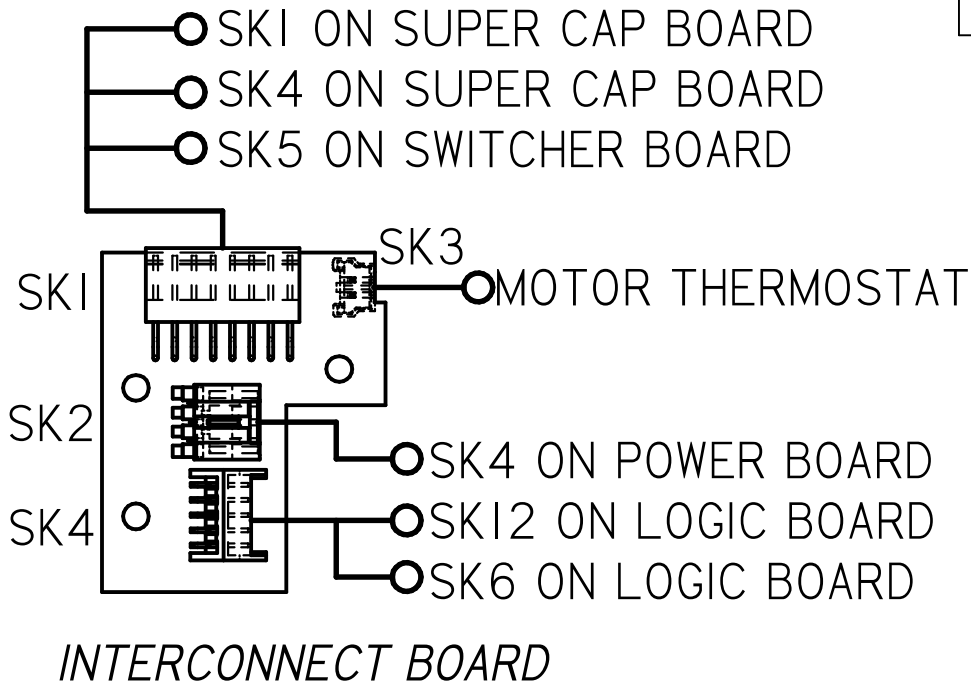

**HMI INTERFACE BOARD**

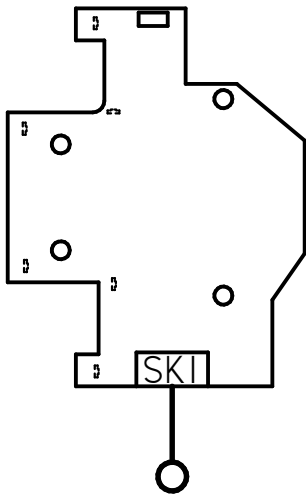

SK3 INTERFACE ON  
SUPER CAP BOARD

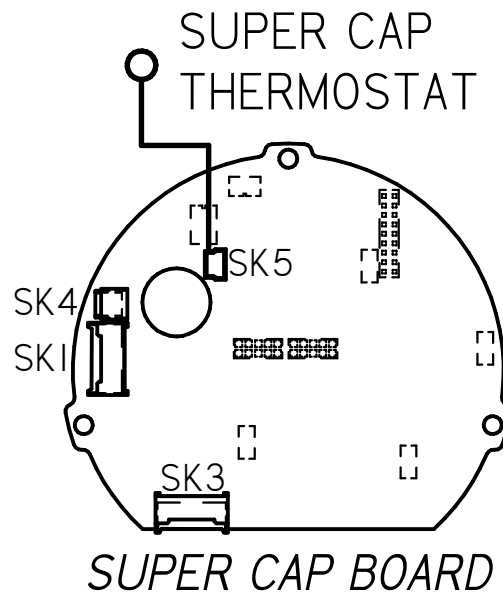

B	ECR 18122 RIRO RENUMBER RELAYS	GVM 6/23/15
A	INITIAL RELEASE	GVM 1-12-15
REV	DESCRIPTION	DATE

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 1-12-15	DATE:	DATE:

**rotork**  
Process Controls  
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : <b>CMA WIRING DIAGRAM</b>		
FOR : AC POWER OPERATION LOCAL CONTROLS AND UPS, RIRO TERMINAL CONNECTIONS		
SHT 2 OF 3	<b>A</b>	<b>M02-DS</b>

RIRO REMOTE INPUTS - DEFAULT SETTINGS



INPUT	FUNCTION	CONTACT FORM
I/P1	CLOSE COMMAND	NORMALLY OPEN
I/P2	STOP/MAINTAIN	NORMALLY OPEN
I/P3	OPEN COMMAND	NORMALLY OPEN
I/P4	ESD	NORMALLY OPEN

REFER TO PUB094-004 FOR FULL DETAILS

RIRO RELAY OUTPUTS- DEFAULT SETTINGS

INPUT	FUNCTION	CONTACT FORM
RELAY 5	NONE	ENERGIZE ON CONDITION
RELAY 6	NONE	ENERGIZE ON CONDITION
RELAY 7	NONE	ENERGIZE ON CONDITION
RELAY 8	NONE	ENERGIZE ON CONDITION

REFER TO PUB094-004 FOR FULL DETAILS

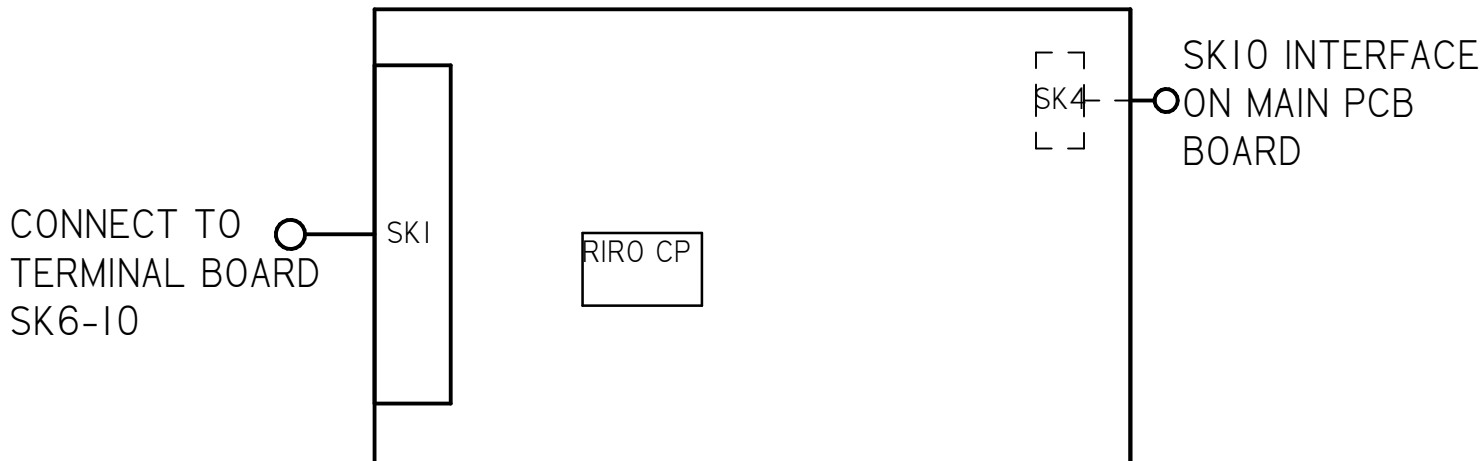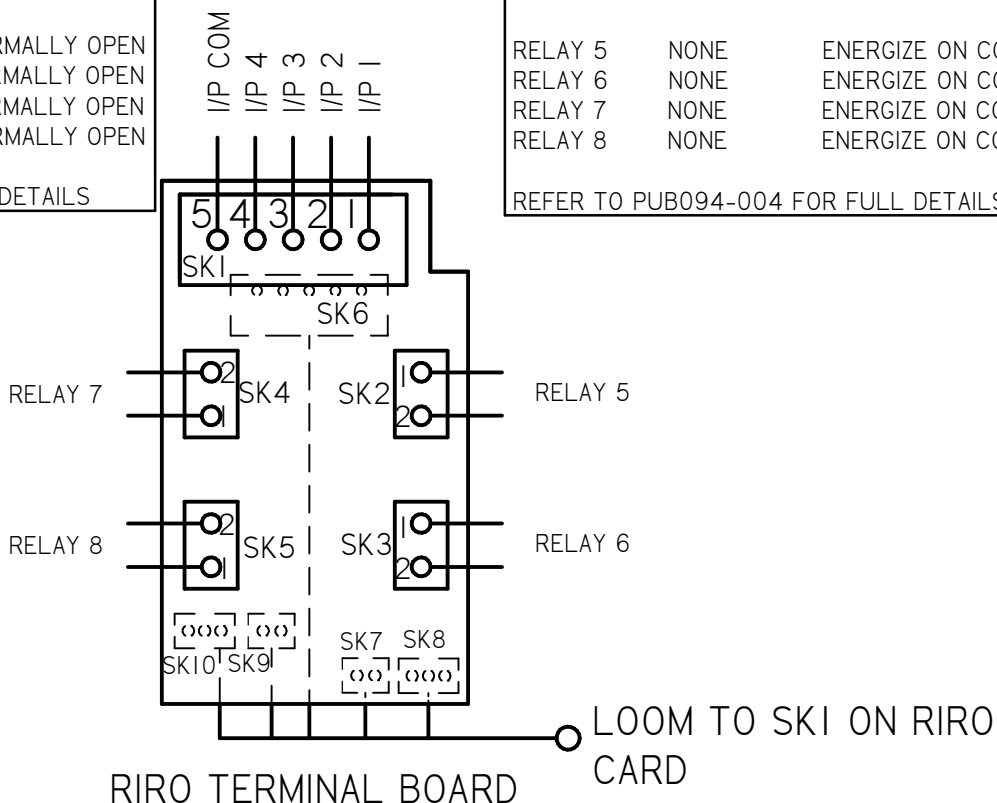

<b>B</b>	ECR 18122 RIRO RENUMBER RELAYS	GVM 6/23/15
<b>A</b>	INITIAL RELEASE	GVM 1-12-15
<b>REV</b>	<b>DESCRIPTION</b>	<b>DATE</b>

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: <b>GVM</b>	PROD. DV.	PROD. ENG.
DATE: <b>1-12-15</b>	DATE:	DATE:

**rotork**  
Process Controls  
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE :  
**CMA WIRING DIAGRAM**

FOR :  
AC POWER OPERATION  
LOCAL CONTROLS AND UPS, RIRO  
TERMINAL CONNECTIONS