NOTES:
1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS WD IF ATTACHED

SHT			REV
1 OF 3	A	M12-NS	A

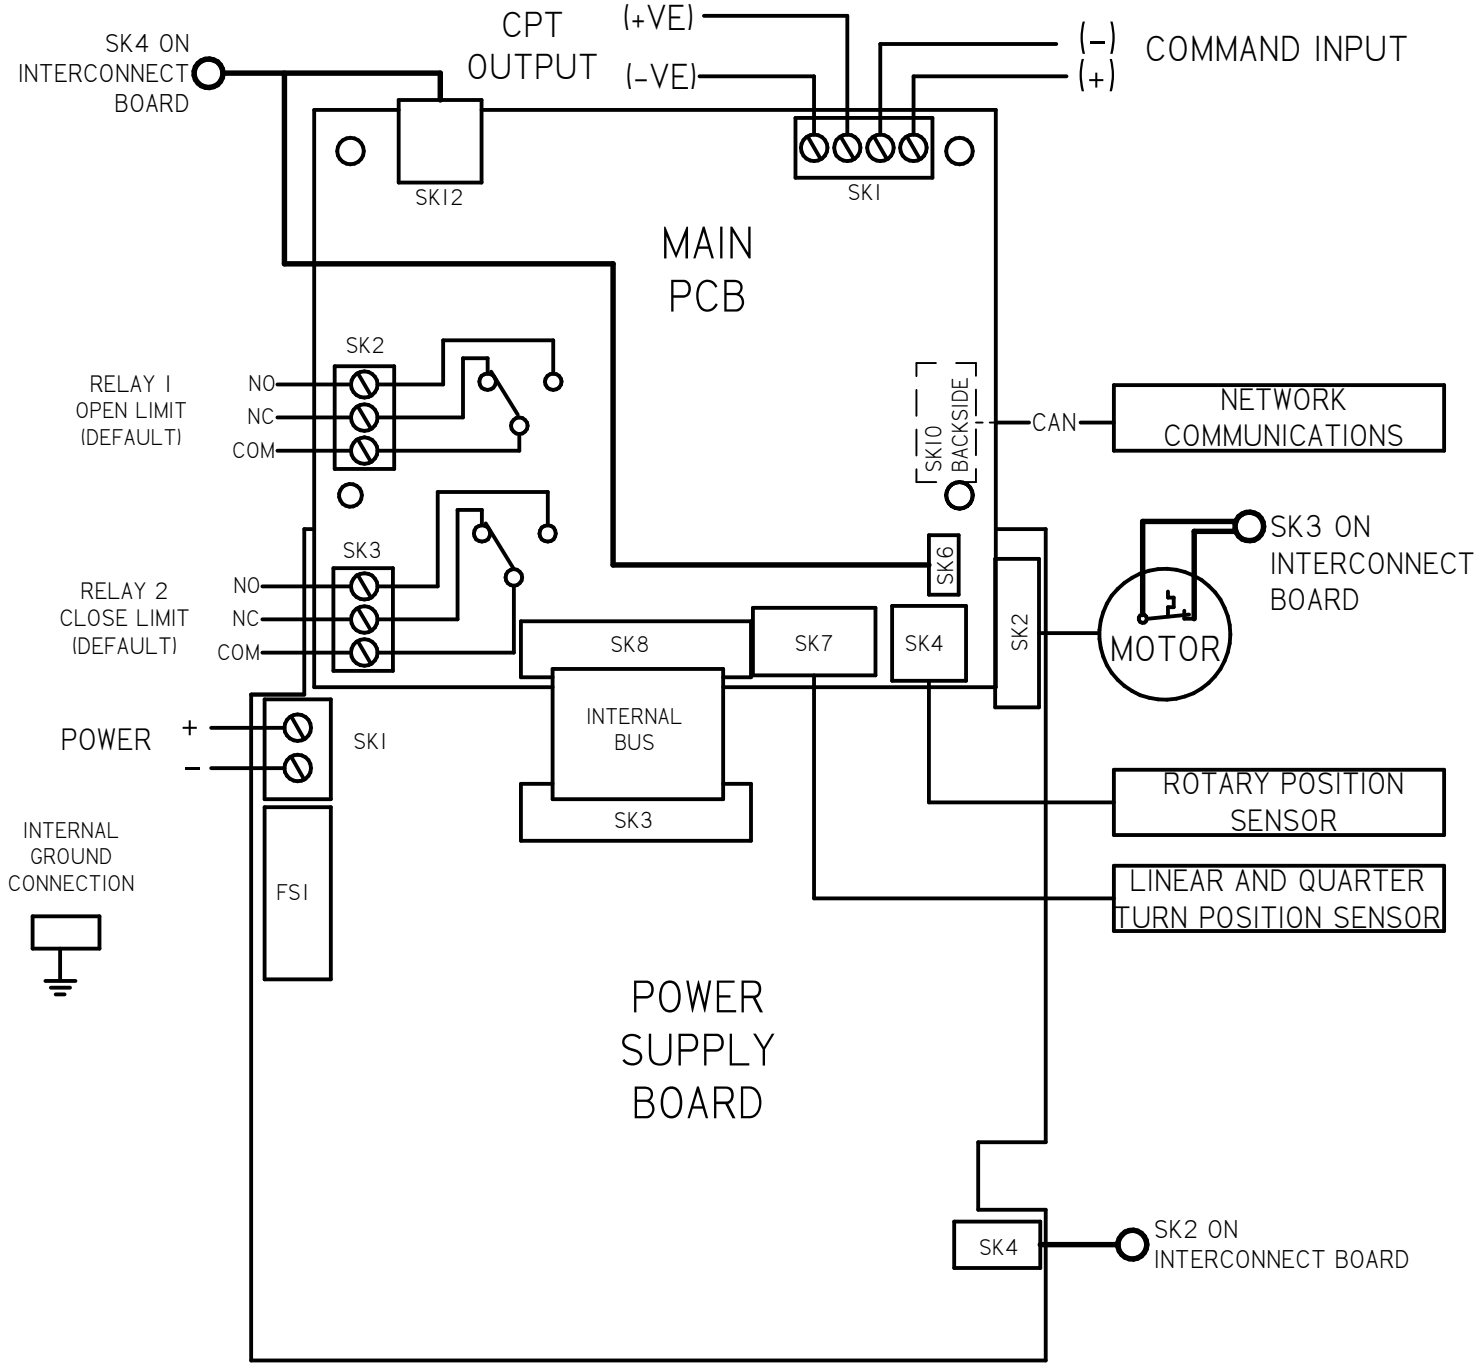

REV	DESCRIPTION	DATE
A	INITIAL RELEASE	GVM 1-12-15

TOLERANCES
UNLESS OTHERWISE SPECIFIED
.XX = ±.02 XXX = ±.005 ANGULAR ±1°

SCALE: NTS

DRAWN:	PROD. DV.	PROD. ENG.
GVM		
DATE:	DATE:	DATE:
1-12-15		

rotork® Process Controls
MILWAUKEE, WISCONSIN, USA

TITLE :
CMA WIRING DIAGRAM

FOR :
DC POWER OPERATION
LOCAL CONTROLS AND UPS, DeviceNet
TERMINAL CONNECTIONS

SHT		
1 OF 3	A	M12-NS

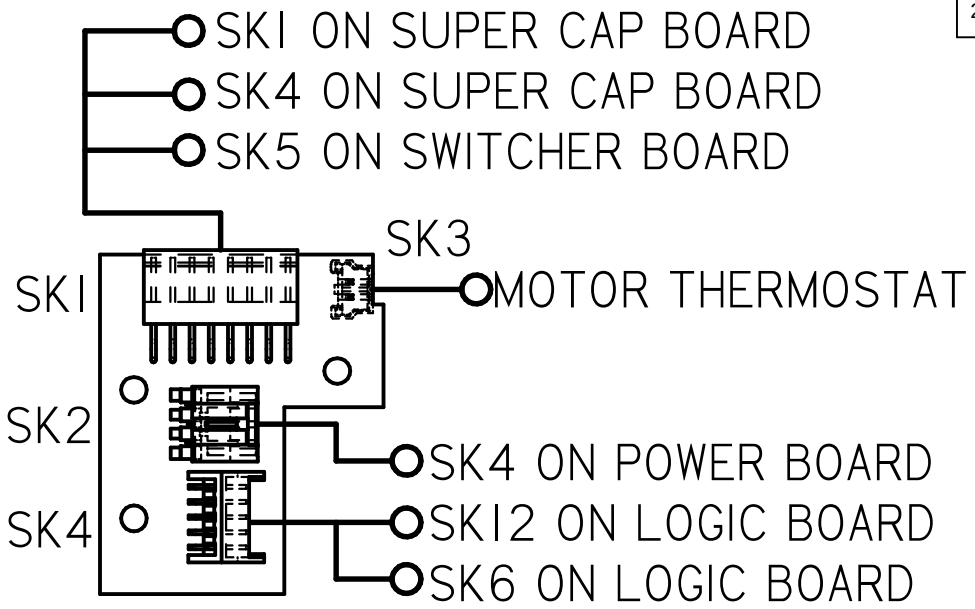

INTERCONNECT BOARD

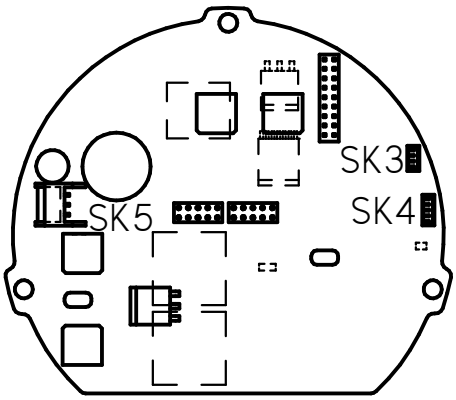

SWITCHER BOARD

HMI INTERFACE BOARD

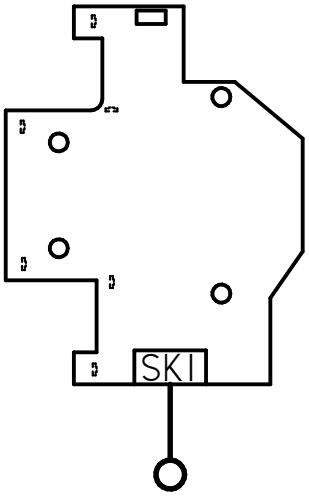

SK3 INTERFACE ON SUPER CAP BOARD

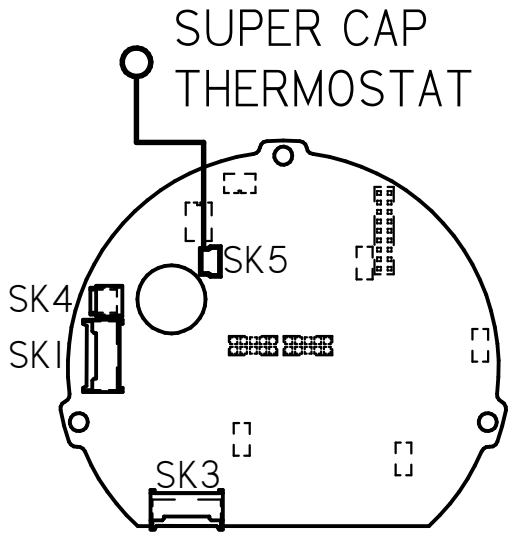

SUPER CAP BOARD

REV	DESCRIPTION	DATE
A	INITIAL RELEASE	GVM 1-12-15

TOLERANCES
UNLESS OTHERWISE SPECIFIED
.XX = ±.02 XXX = ±.005 ANGULAR ±1°

SCALE: NTS

DRAWN:	PROD. DV.	PROD. ENG.
GVM		
DATE: 1-12-15	DATE:	DATE:

rotork® Process Controls
MILWAUKEE, WISCONSIN, USA

TITLE :
CMA WIRING DIAGRAM

FOR :
DC POWER OPERATION
LOCAL CONTROLS AND UPS, DeviceNet
TERMINAL CONNECTIONS

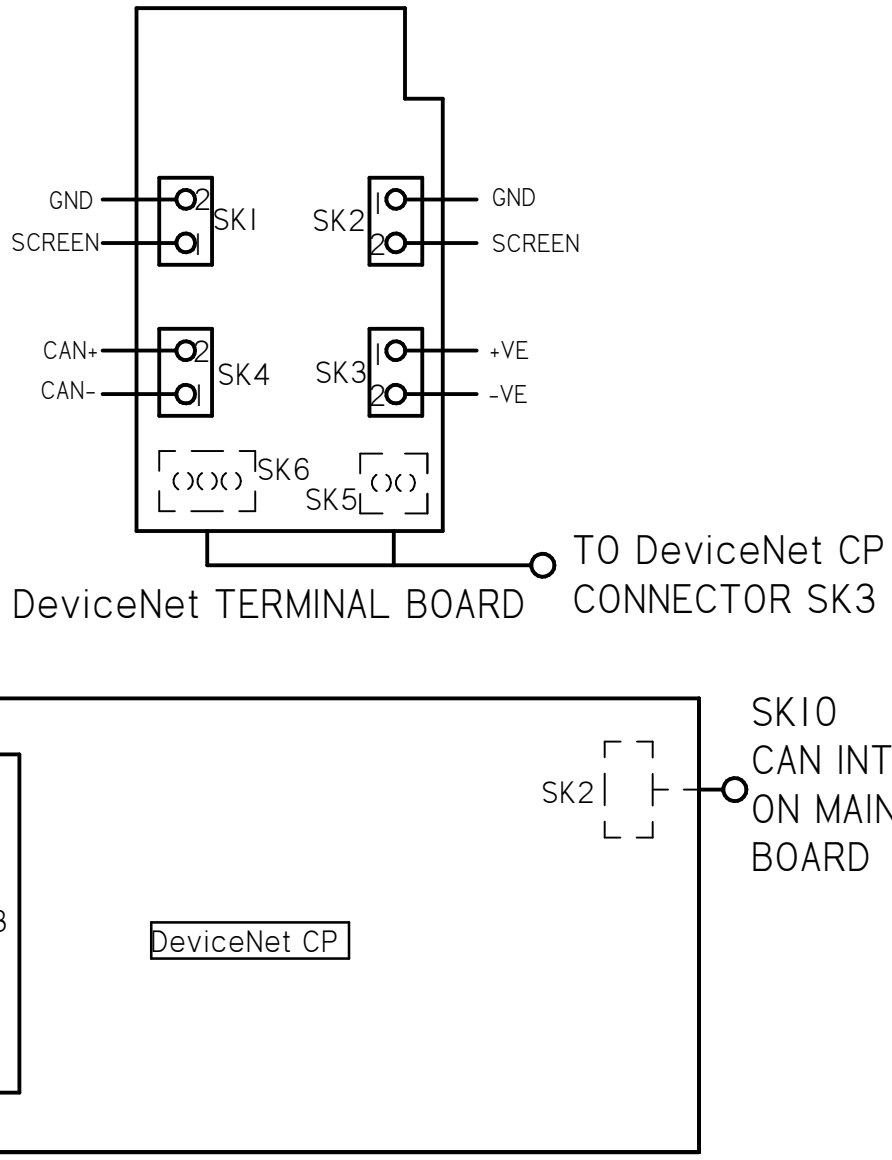

REV	DESCRIPTION	DATE
A	INITIAL RELEASE	GVM 1-12-15

TOLERANCES
UNLESS OTHERWISE SPECIFIED
.XX = ±.02 XXX = ±.005 ANGULAR ±1°

SCALE: NTS

DRAWN:	PROD. DV.	PROD. ENG.
GVM		
DATE:	DATE:	DATE:
1-12-15		

rotork® Process Controls
MILWAUKEE, WISCONSIN, USA

TITLE :
CMA WIRING DIAGRAM

FOR :
DC POWER OPERATION
LOCAL CONTROLS AND UPS, DeviceNet
TERMINAL CONNECTIONS