


	<u>Date</u> <u>Chkd</u> 170215 PJW		First Issue.			IQM + 120VAC CUSTOMER SUPPLY + FOLOMATIC & CPT + RHS		
			CAN description: "+24 (RHS)" and "0V (RHS)" was "24V (V_CUST)" & "GND" respectively.	,	ROCHESTER	Drawn by: JJB Date : 170215 Base WD: 213B0006 Job No :	0400000	Sheet No 1
3	040816		Updated notes on page 2 for modulating.	Tel:01225-733200	Tel:585-247-2304	MI No :	B1 C1 B2 C2	o f 2

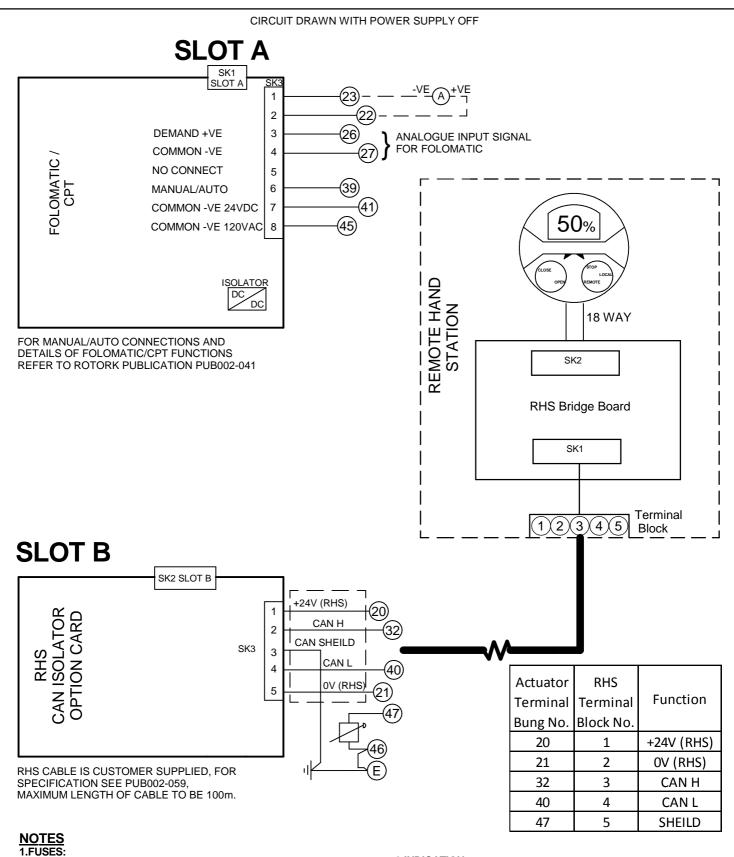

- -PS1 is a self-resetting fuse.
- -Refer to publication PUB002-039 for approved fuses FS1 and FS2.
- -Actuator rated voltage specified on nameplate. Voltage tolerance +/-10%, applies for rated torque performance; duty cycle is not guaranteed.

2.REMOTE CONTROL:

- -For typical remote control circuits refer to: -RWS indicated or PUB002-041.
- -For DC control, connect -ve to terminal 36.
- -(For negative switch / positive common, refer to RWS indicated).
- -Control signal threshold voltages:
- -DC: "on" ≥16Vdc / "off" ≤8Vdc, max 60Vdc.
- -Control signal duration to be 100ms minimum.
- -Maximum current drawn from remote control signals is:
- -8mA at 24Vdc
- -Supply provided on terminals 4 & 5:
- -NOT Intended for remote control.
- -Max external load 5VA at 120Vac

3.INDICATION:

- -For typical position, status and alarm indication see PUB002-041. -"S" contacts are user configurable and are shown in their default
- -Refer to PUB002-040 for functions and configuration instructions. -Monitor Relay indicates actuator availability for remote control (shown
- "unavailable"). It can be configured to exclude local/remote selection. -Refer to PUB002-040 for monitored functions and configuration instructions
- -Voltage applied to indication contacts must not exceed 150Vac -Individual Switch current must not exceed 3.5A inductive, 5A resistive and no more than 8A in total for all 4 contacts.

- -Battery maintains local and remote "S" contact indication only.
- -Refer to installation manual for approved replacement battery types.

Circuit Diagram Number 213B0006