

CIRCUIT DRAWN WITH
POWER SUPPLY OFF

FOR TYPICAL REMOTE CONTROL
DETAILS SEE DOCUMENT
RWS320


TRANSFORMER TAPPING OPTIONS

TYPE 1			TYPE 2		
TAP	NOM	RANGE	TAP	NOM	RANGE
X	100	80-120	X	200	160-240
Y	110	88-132	Y	230	184-276
Z	120	96-144	Z	270	216-324
FS1-250mA A/S FS2-5A A/S			FS1-150mA A/S FS2-2.5A A/S		

TYPE 3			TYPE 4		
TAP	NOM	RANGE	TAP	NOM	RANGE
X	380	304-456	X	480	384-576
Y	400	320-480	Y	575	460-690
Z	415	332-498	Z	690	552-828
FS1-100mA A/S FS2-1.5A A/S			FS1-50mA A/S FS2-1.6A F/A		

TRANSFORMER TYPES 1, 2, 3 & 4 -
FUSE FS3 - 20A ATO FAST ACTING

TYPE 5 24VDC

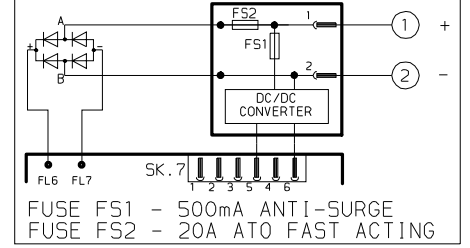

ALL TRANSFORMER TYPES -
PS1 SELF-RESETTING FUSE


NOTE

REFER TO PUBLICATION E175E3 FOR
APPROVED FUSES FS1 AND FS2.

SIL2/3 APPLICATIONS

ACTUATOR IS TuV CERTIFIED FOR SIL2/3
APPLICATIONS ONLY WHEN INSTALLED,
COMMISSIONED, OPERATED & MAINTAINED
IN STRICT ACCORDANCE WITH THE IQ PRO
SAFETY MANUAL - PUBLICATION E173E3.
MAX LOAD ON TERMINALS 4 & 5 = 5W
REMOTE CONTROL SIGNAL THRESHOLD
VOLTAGES FOR GUARANTEED OPERATION:
"ON" = ≥20V / "OFF" = ≤3V
MINIMUM SIGNAL DURATION = ≥100ms
NOMINAL CURRENT DRAWN FROM EACH
CONTROL SIGNAL IS 5mA

LINK FITTED BY ROTORK

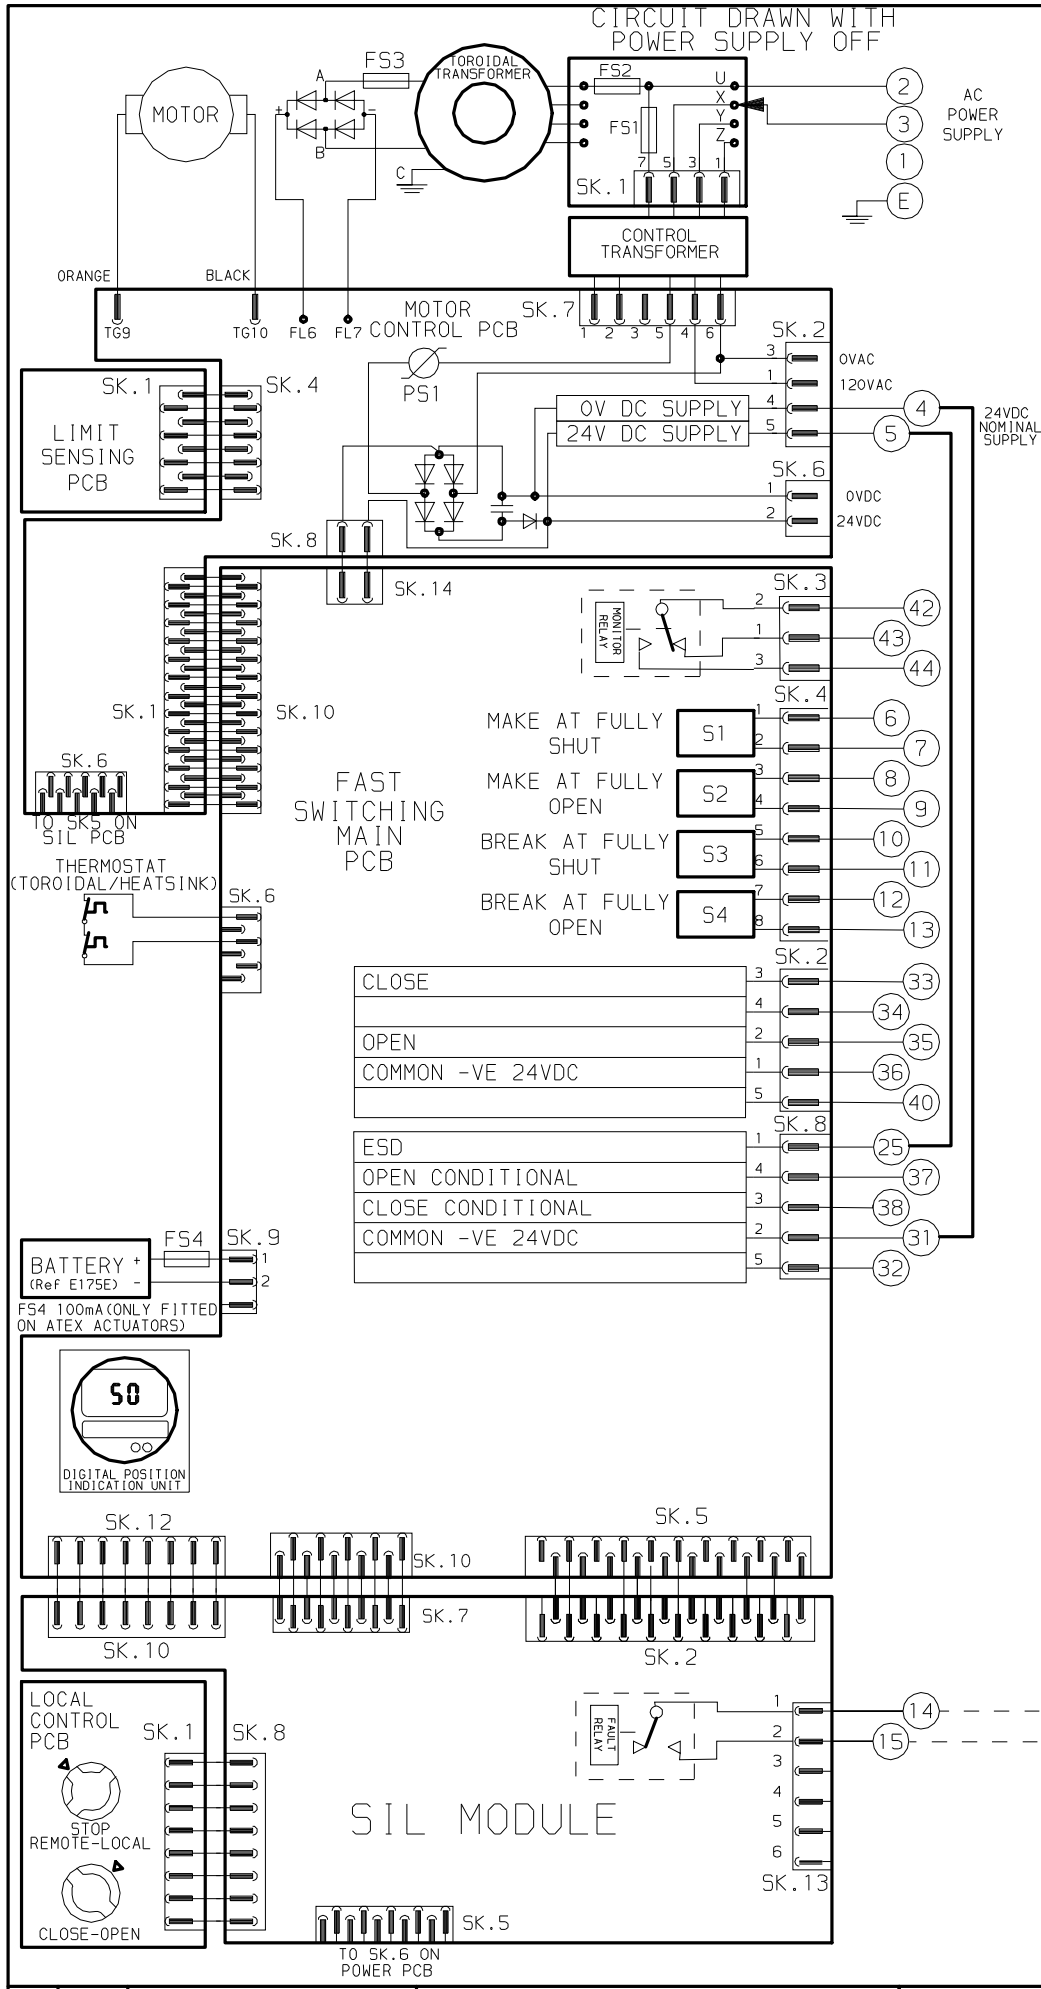

INDICATION CONTACTS S1-S4 ARE SHOWN
IN THEIR DEFAULT CONFIGURATION.
CONTACTS MAY BE CONFIGURED FOR ANY
OF THE FUNCTIONS DESCRIBED IN E175E3

No 01	DATE	REVISION DETAILS	www.rotork.com		CONFIG BY JC1	IQTM + SIL PCB
			ROTORK CONTROLS LTD BATH, BA1 3JQ ENGLAND Tel: 01225-733200	ROTORK CONTROLS INC ROCHESTER NY 14624, USA Tel: 585-247-2304	DATE 120615 CHECKED PJW BASE WD 70005000 JOB No - M.I.No -	
CIRCUIT DIAGRAM No -REV 70005000-01						B1 C1 B2 C2