


CIRCUIT DRAWN WITH
POWER SUPPLY OFF

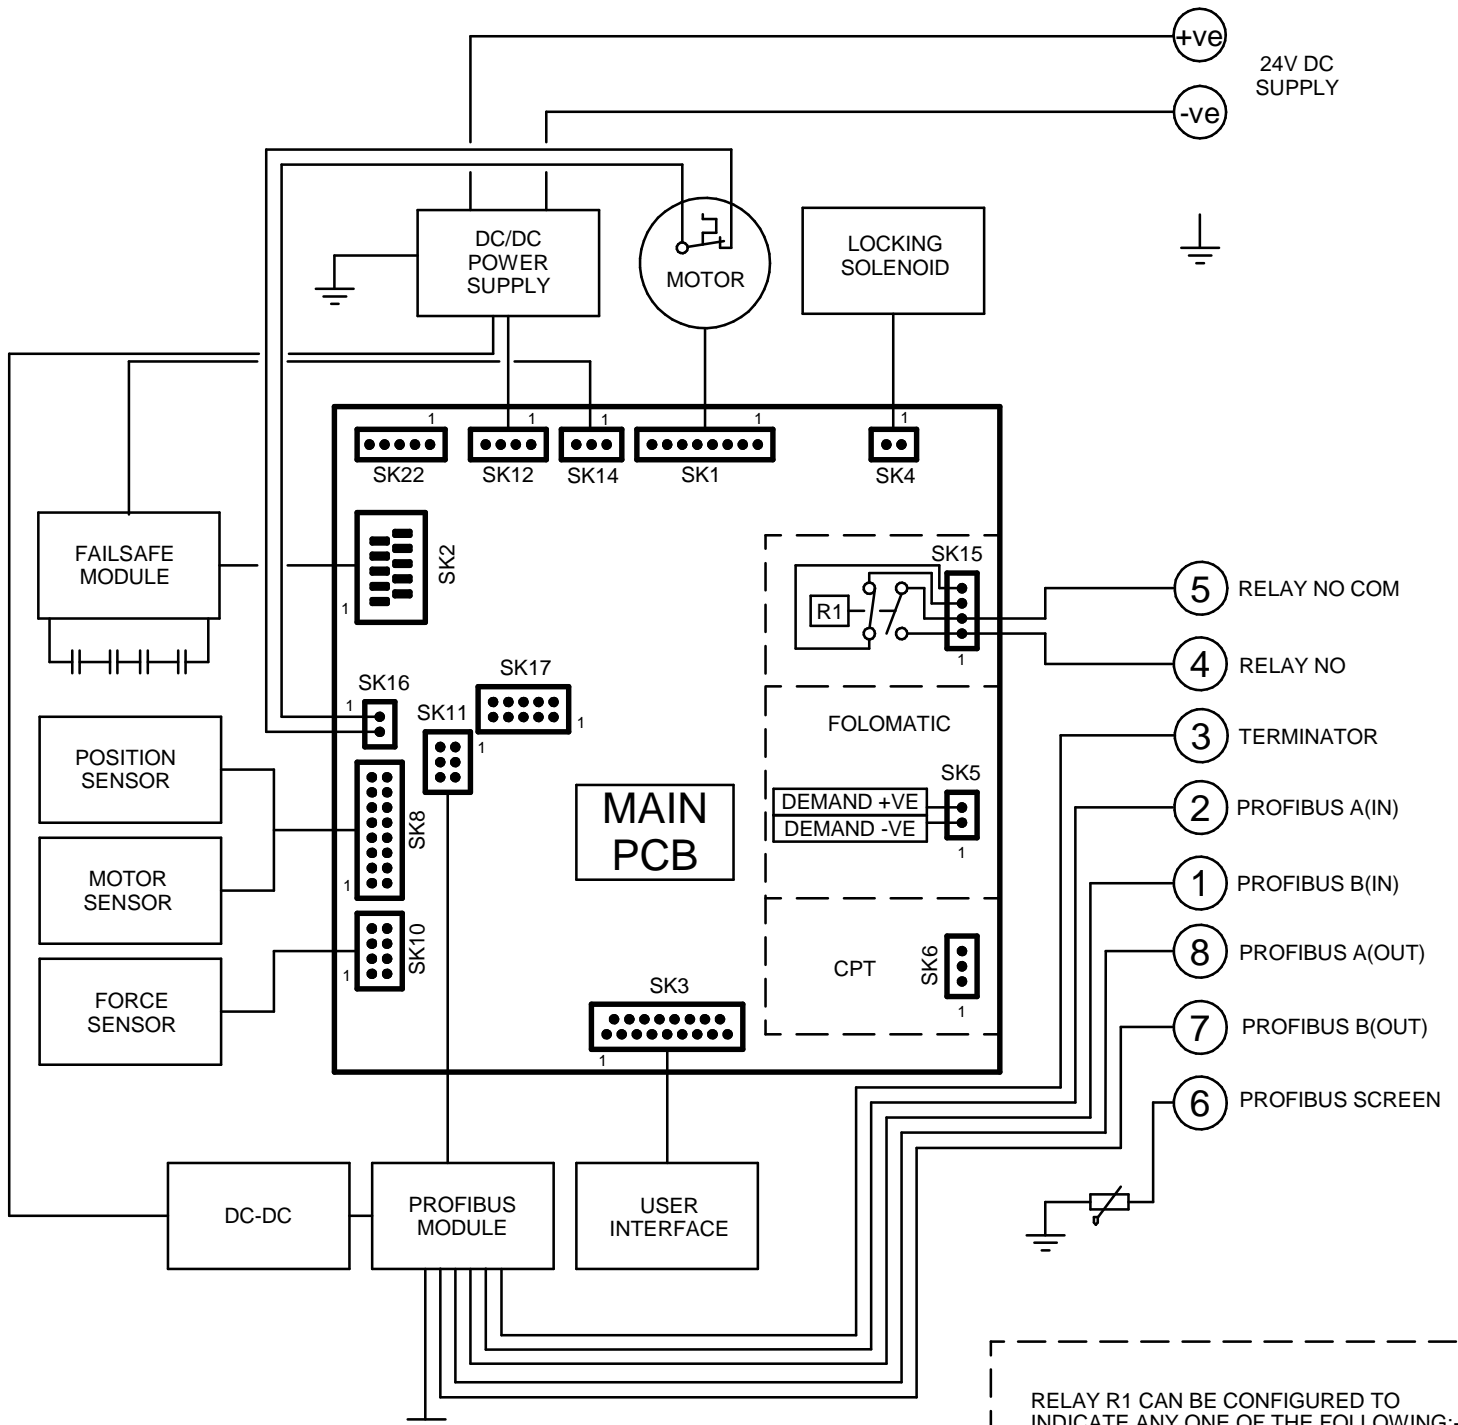

- (+) 24V DC SUPPLY
- (-) 24V DC SUPPLY
- (5) RELAY NO COM
- (4) RELAY NO
- (3) TERMINATOR
- (2) PROFIBUS A(IN)
- (1) PROFIBUS B(IN)
- (8) PROFIBUS A(OUT)
- (7) PROFIBUS B(OUT)
- (6) PROFIBUS SCREEN

RELAY R1 CAN BE CONFIGURED TO INDICATE ANY ONE OF THE FOLLOWING:-

- 0 DISABLED
- 1 REMOTE CONTROL AVAILABLE
- 2 FAULT
- 3 FULLY OPEN
- 4 FULLY CLOSED
- 5 FORCE TRIP OPENING
- 6 FORCE TRIP CLOSING
- 7 FORCE TRIP ANY POSITION
- 8 FAILSAFE OPERATION

UPS SOCKET FOR
CVL5000 / CVQ6000



WHEN MANUAL
OVERRIDE IS FITTED
MOTOR DISABLE
SWITCH FITTED IN
SERIES WITH
THERMOSTAT (SK16)

Iss	Date	Chkd	Revision Details
1	040815	JC1	First Issue.

www.rotork.com

ROTORK CONTROLS LTD
BATH, BA1 3JQ
ENGLAND
Tel:01225-733200

ROTORK CONTROLS INC
ROCHESTER
NY 14624, USA
Tel:585-247-2304

CVA, D/C SUPPLY, N/O CONTACT,
LOCK SOL + MOR, FAILSAFE & P/BUS

Drawn by: PJW
Date : 040815
Base WD: C32-90
Job No : - -
MI No : - -

Circuit Diagram No	Issue No
C32-90	1