

NOTES:

1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT
1 OF 3

A


M02-F0

REV
A

SKI INTERFACE ON HMI INTERFACE BOARD

CPT (+VE) OUTPUT (-VE)

(-) COMMAND INPUT (+)

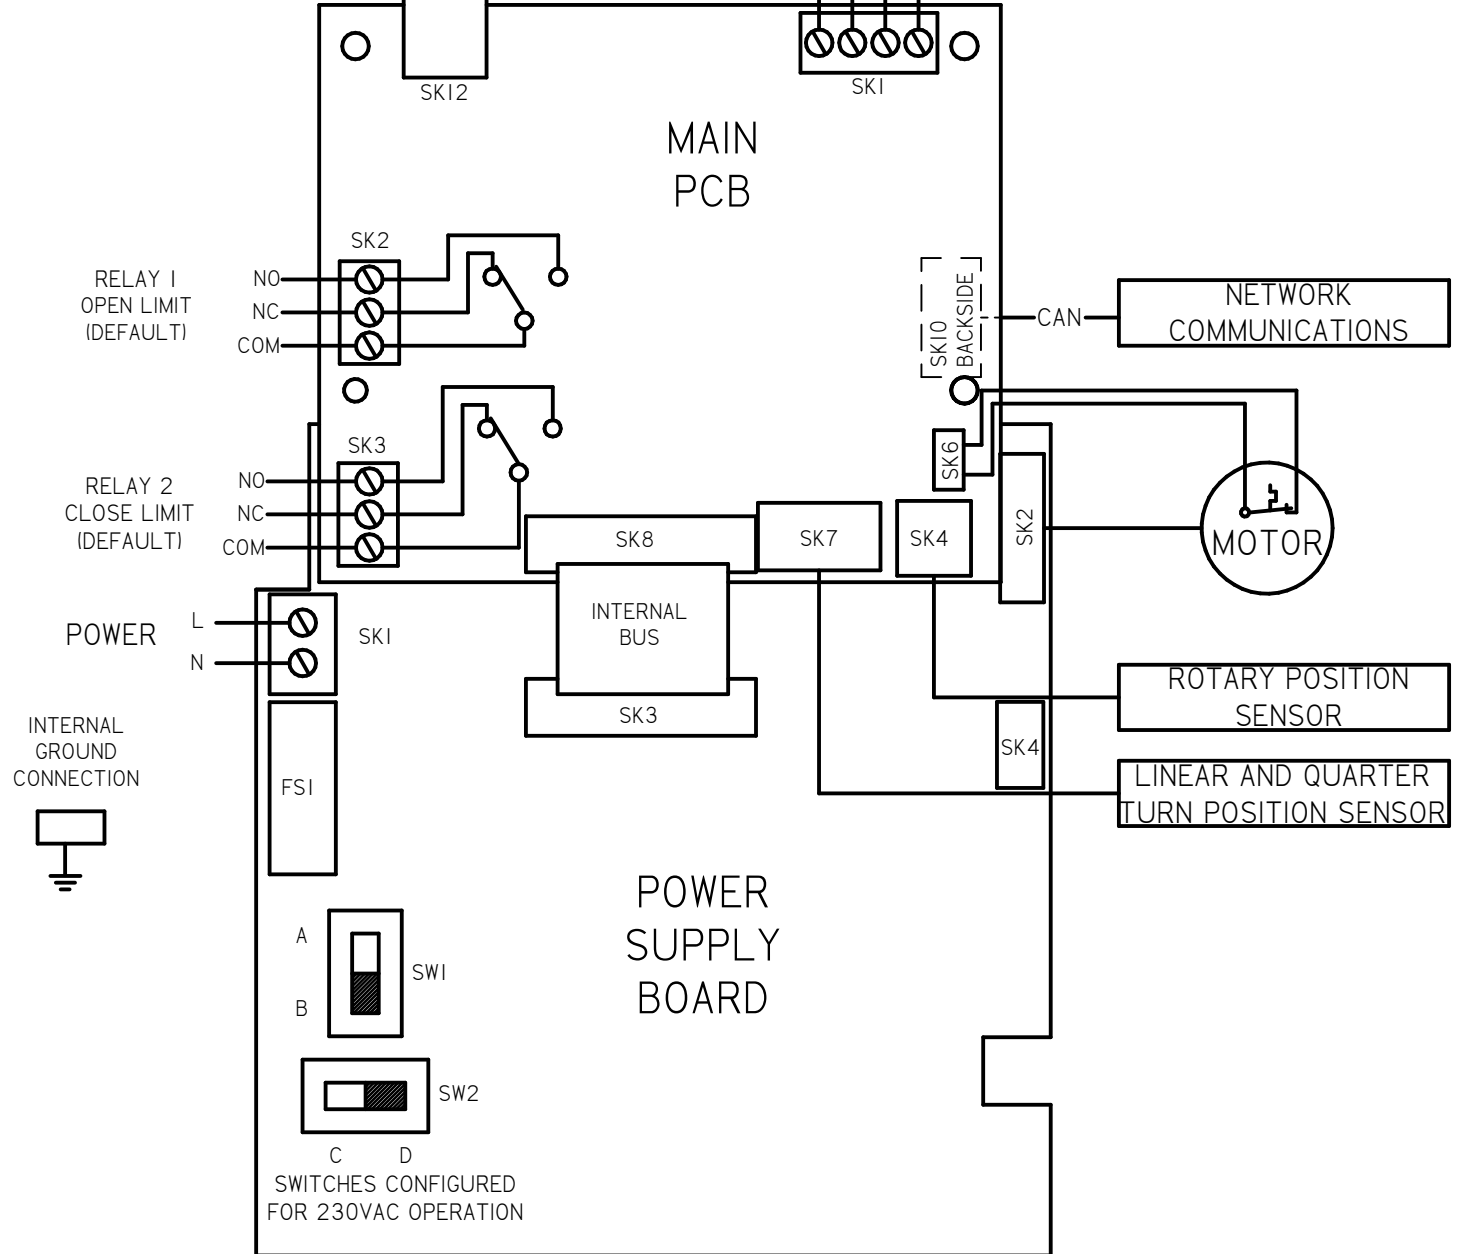

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D

REV	DESCRIPTION	DATE
A	INITIAL RELEASE	GVM 12-29-17

TOLERANCES
UNLESS OTHERWISE SPECIFIED
.XX = ±.02 XXX = ±.005 ANGULAR ±1°

SCALE: **NTS**

DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 1-12-15	DATE:	DATE:

rotork
Process Controls
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE :
CMA WIRING DIAGRAM

FOR :
AC POWER OPERATION
LOCAL CONTROLS, FOUNDATION
FIELDBUS TERMINAL CONNECTIONS

SHT 1 OF 3	A	M02-F0
---------------	----------	---------------

HMI INTERFACE BOARD



SKI2 INTERFACE ON
MAIN PCB BOARD



A	INITIAL RELEASE	GVM 12-29-17
REV	DESCRIPTION	DATE


<p>TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°</p>		
<p>SCALE: NTS</p>		
DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 1-12-15	DATE:	DATE:

rotork[®]
Process Controls
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

<p>TITLE : CMA WIRING DIAGRAM</p>		
<p>FOR : AC POWER OPERATION LOCAL CONTROLS, FOUNDATION FIELDBUS TERMINAL CONNECTIONS</p>		
SHT 2 OF 3	A	M02-F0

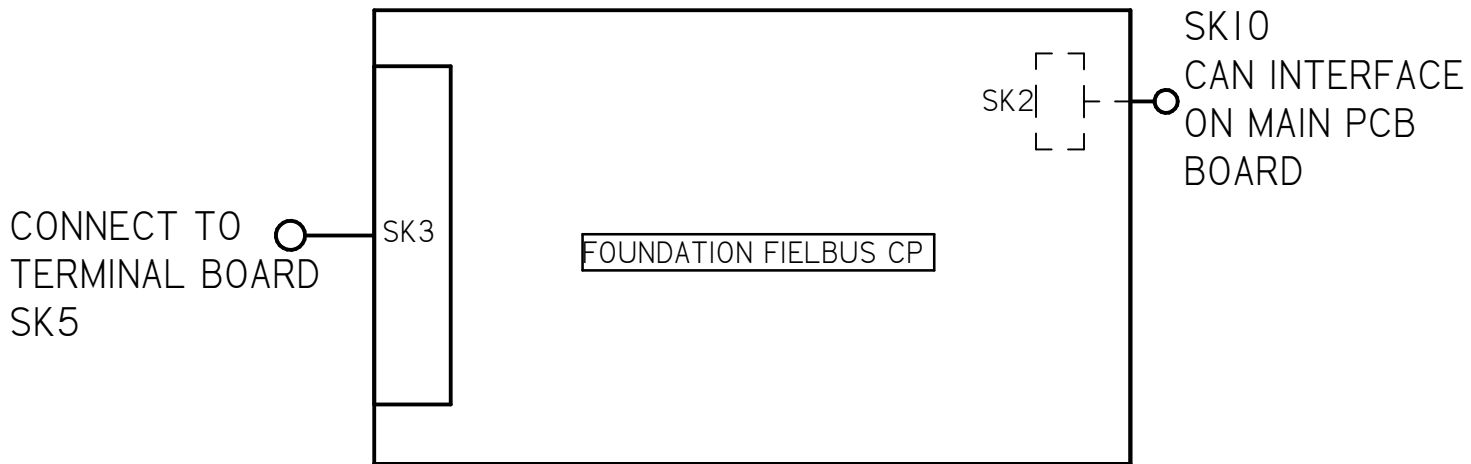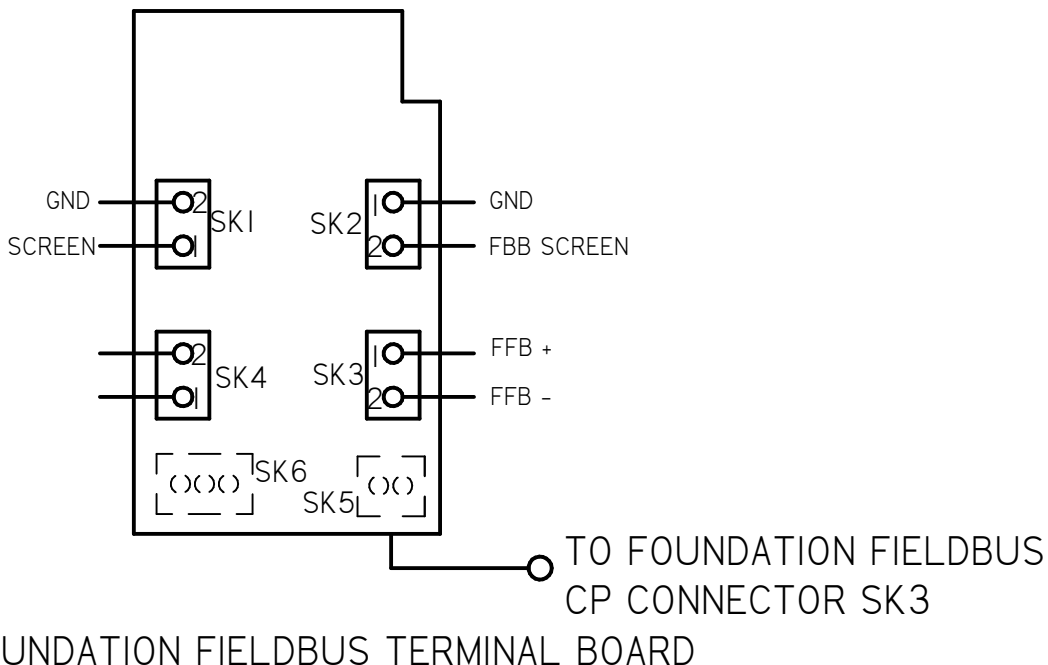

A	INITIAL RELEASE	GVM	12-29-17		
REV	DESCRIPTION	DATE			
TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°			 MILWAUKEE, WISCONSIN, USA		TITLE : CMA WIRING DIAGRAM
SCALE: NTS					FOR : AC POWER OPERATION LOCAL CONTROLS, FOUNDATION FIELDBUS TERMINAL CONNECTIONS
DRAWN:	PROD. DV.	PROD. ENG.	This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.		SHT 3 OF 3 A M02-F0
DRAWN: GVM					DATE: 1-12-15