


NOTES:

- 1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
- 2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

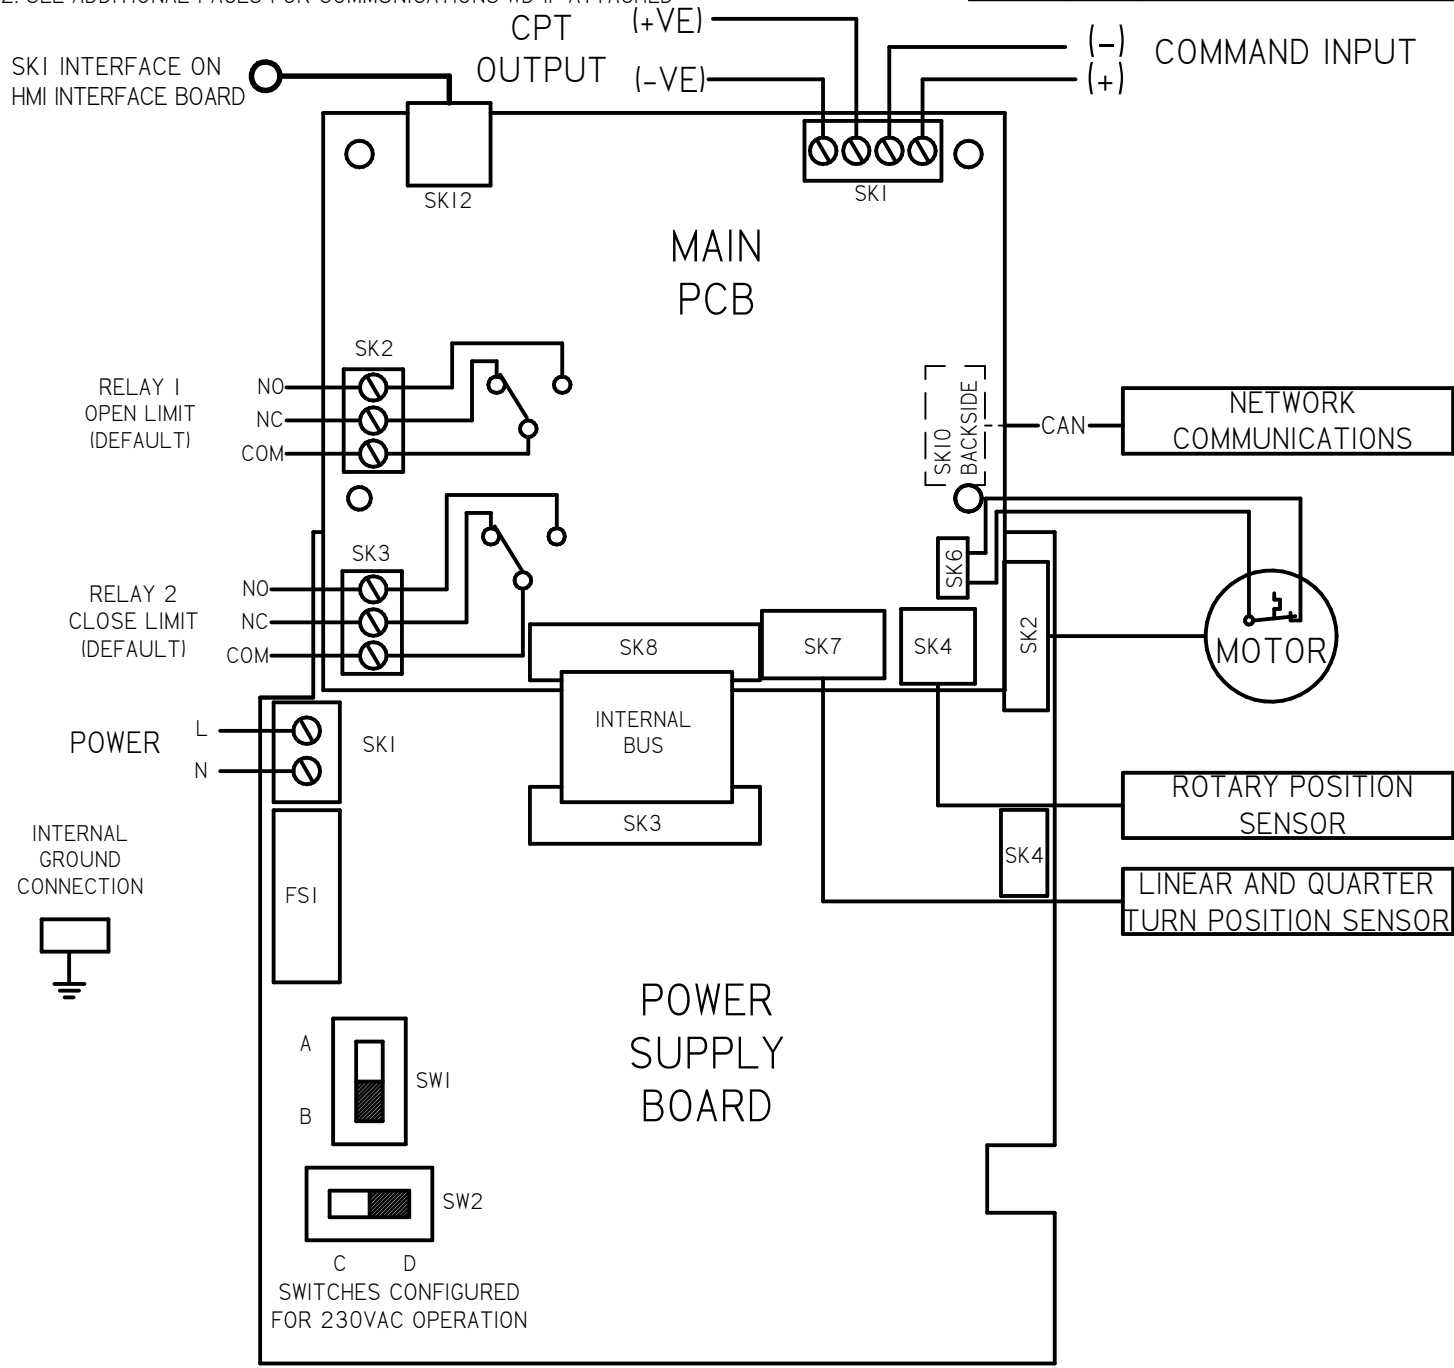

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D

A	INITIAL RELEASE	GVM 12-29-17
REV	DESCRIPTION	DATE

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: <b>GVM</b>	PROD. DV.	PROD. ENG.
DATE: <b>1-12-15</b>	DATE:	DATE:

**rotork<sup>®</sup>**  
**Process Controls**  
 MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : **CMA WIRING DIAGRAM**


FOR :  
 AC POWER OPERATION  
 LOCAL CONTROLS, DeviceNet TERMINAL CONNECTIONS



SHT 1 OF 3	<b>A</b>	M02-N0
---------------	----------	--------

# HMI INTERFACE BOARD



SKI2 INTERFACE ON  
MAIN PCB BOARD

A	INITIAL RELEASE	GVM	12-29-17		
REV	DESCRIPTION	DATE			
<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°			 MILWAUKEE, WISCONSIN, USA		TITLE : <b>CMA WIRING DIAGRAM</b>
SCALE: <b>NTS</b>					FOR : AC POWER OPERATION LOCAL CONTROLS, DeviceNet TERMINAL CONNECTIONS
DRAWN: GVM	PROD. DV.	PROD. ENG.	This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.		SHT 2 OF 3 <b>A</b> M02-N0
DATE: 1-12-15	DATE:	DATE:			

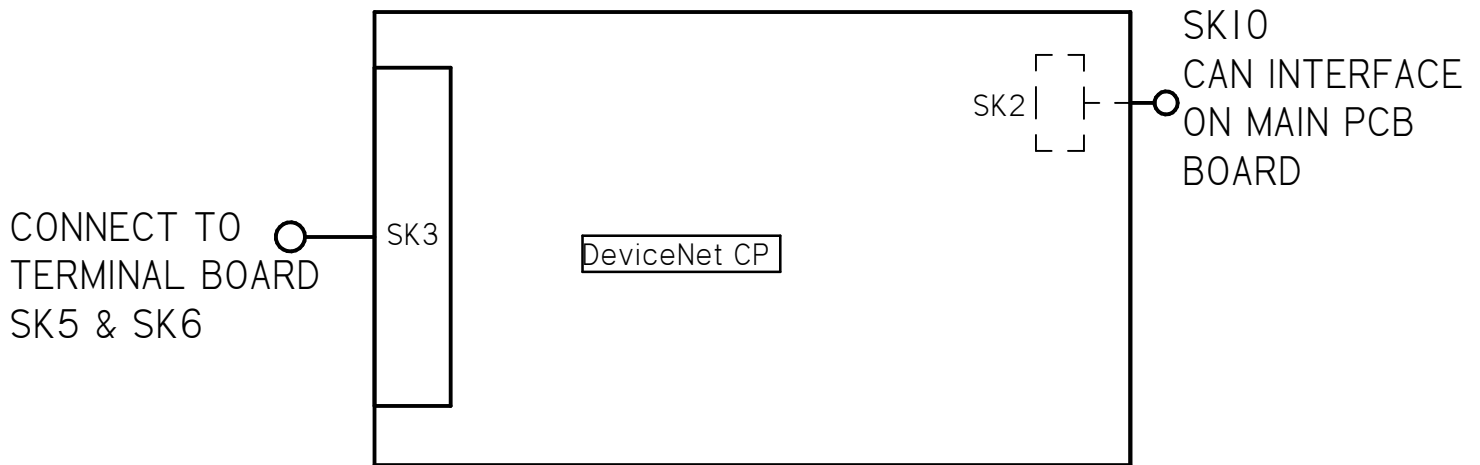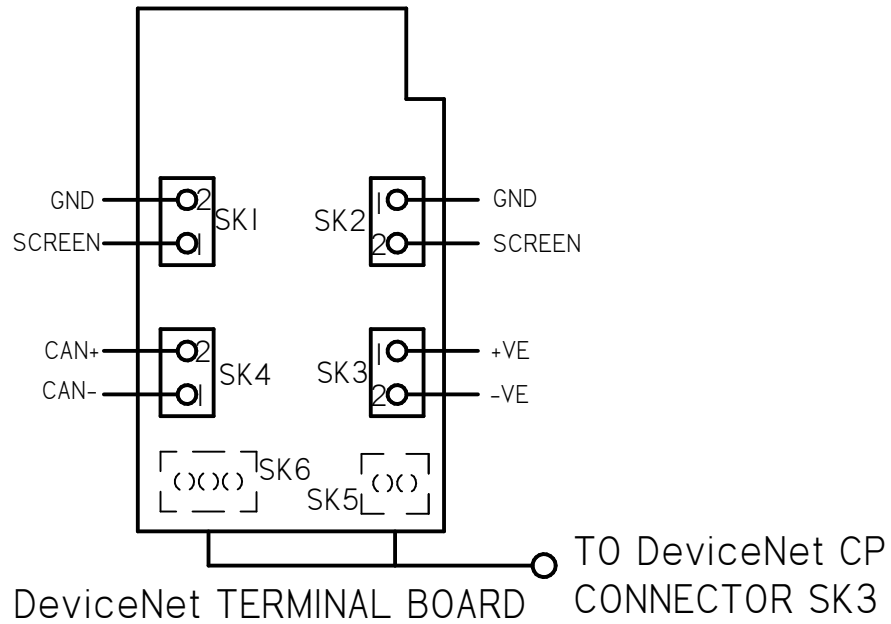

<b>A</b>	INITIAL RELEASE	GVM 12-29-17
REV	DESCRIPTION	DATE

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: <b>GVM</b>	PROD. DV.	PROD. ENG.
DATE: <b>1-12-15</b>	DATE:	DATE:

**rotork**<sup>®</sup>  
**Process Controls**  
 MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : <b>CMA WIRING DIAGRAM</b>		
FOR : AC POWER OPERATION LOCAL CONTROLS, DeviceNet TERMINAL CONNECTIONS		
SHT 3 OF 3	<b>A</b>	<b>M02-N0</b>