

NOTES:

1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT
1 OF 3

A


M02-20

REV
A

SKI INTERFACE ON HMI INTERFACE BOARD

CPT (+VE) OUTPUT (-VE)

(-) COMMAND INPUT (+)

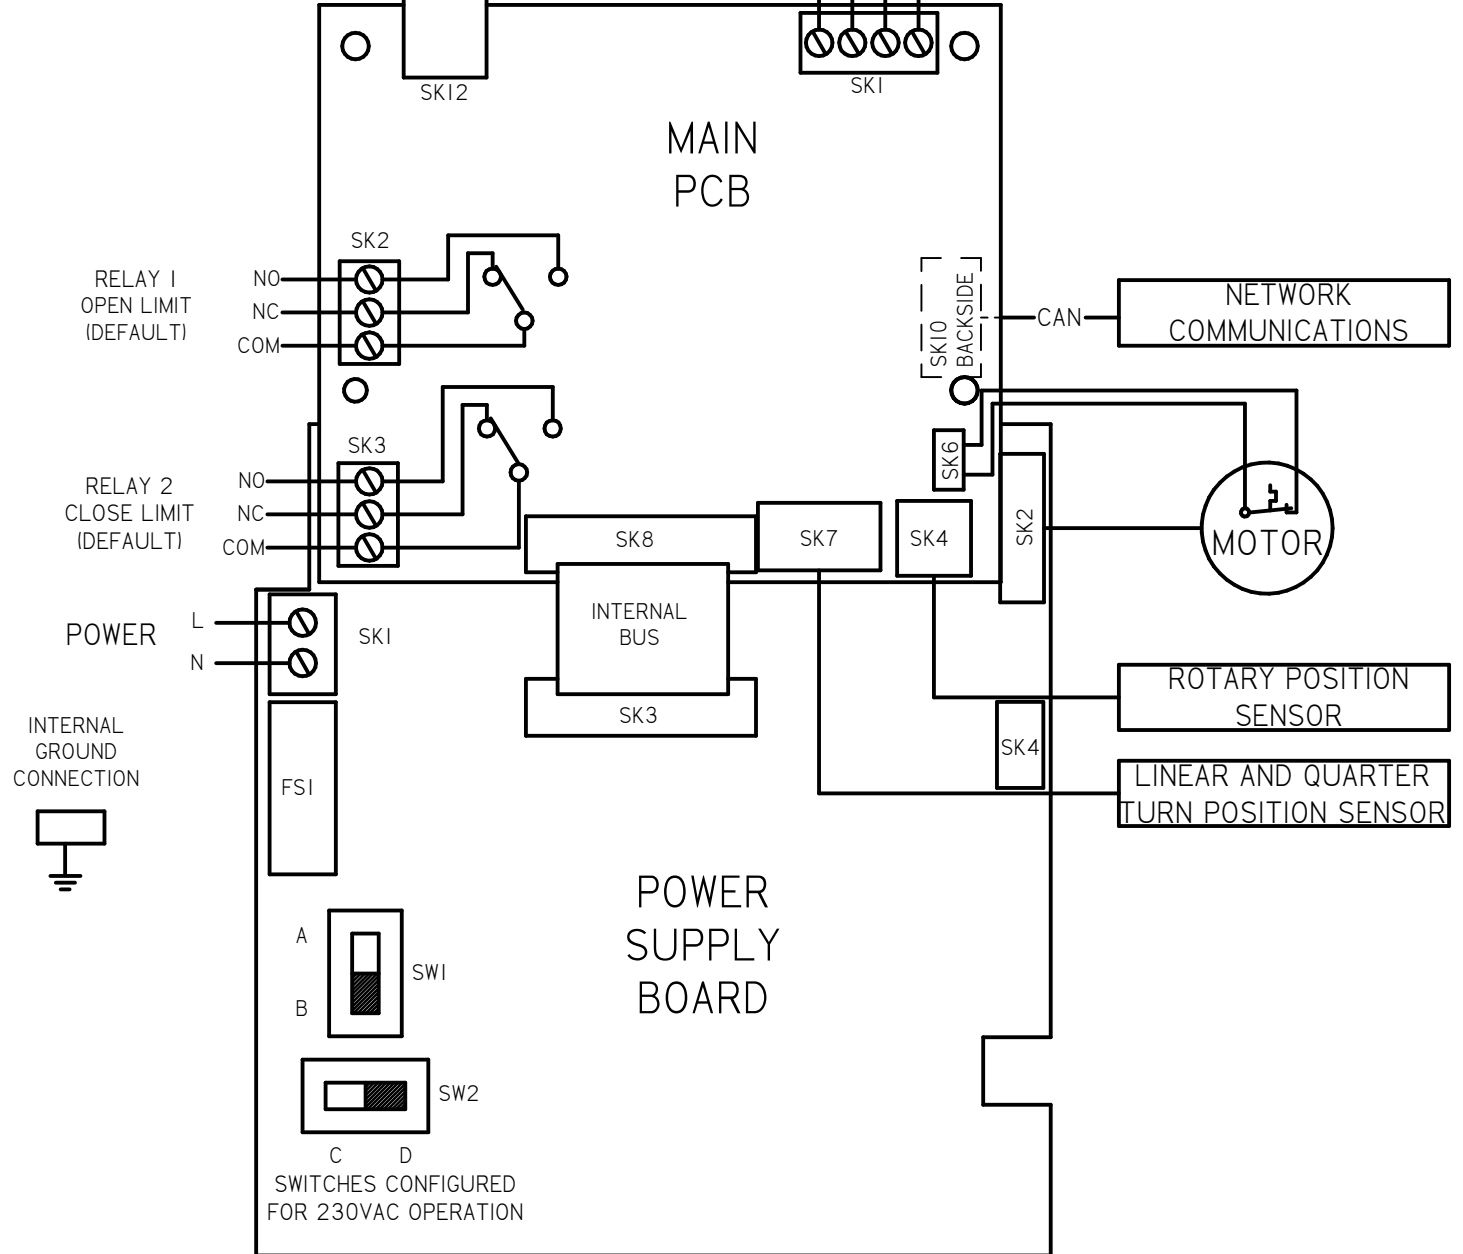

| INPUT VOLTAGE | SW1 | SW2 |
|---------------|-----|-----|
| 110 VAC | A | C |
| 115 VAC | A | D |
| 208 VAC | B | C |
| 230 VAC | B | D |

| REV | DESCRIPTION | DATE |
|-----|-----------------|-----------------|
| A | INITIAL RELEASE | GVM 12-29-17 |

| | | |
|---|-----------|------------|
| TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1° | | |
| SCALE: NTS | | |
| DRAWN: GVM | PROD. DV. | PROD. ENG. |
| DATE: 6/23/15 | DATE: | DATE: |

rotork[®]
Process Controls
MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : **CMA WIRING DIAGRAM**


FOR :
AC POWER OPERATION
LOCAL CONTROLS,CURRENT TORQUE TRANSMITTER
TERMINAL CONNECTIONS



SHT
1 OF 3 **A** M02-20

HMI INTERFACE BOARD




SKI2 INTERFACE ON
MAIN PCB BOARD

| | | | | | |
|---|-----------------|------------|--|--|--------------------------------------|
| | | | | | |
| A | INITIAL RELEASE | GVM | 12-29-17 | | |
| REV | DESCRIPTION | DATE | | | |
| TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1° | | |  MILWAUKEE, WISCONSIN, USA | | TITLE : CMA WIRING DIAGRAM |
| SCALE: NTS | | | FOR : AC POWER OPERATION LOCAL CONTROLS,CURRENT TORQUE TRANSMITTER TERMINAL CONNECTIONS | | |
| DRAWN: GVM | PROD. DV. | PROD. ENG. | This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved. | | SHT 2 OF 3 A M02-20 |
| DATE: 6/23/15 | DATE: | DATE: | | | |

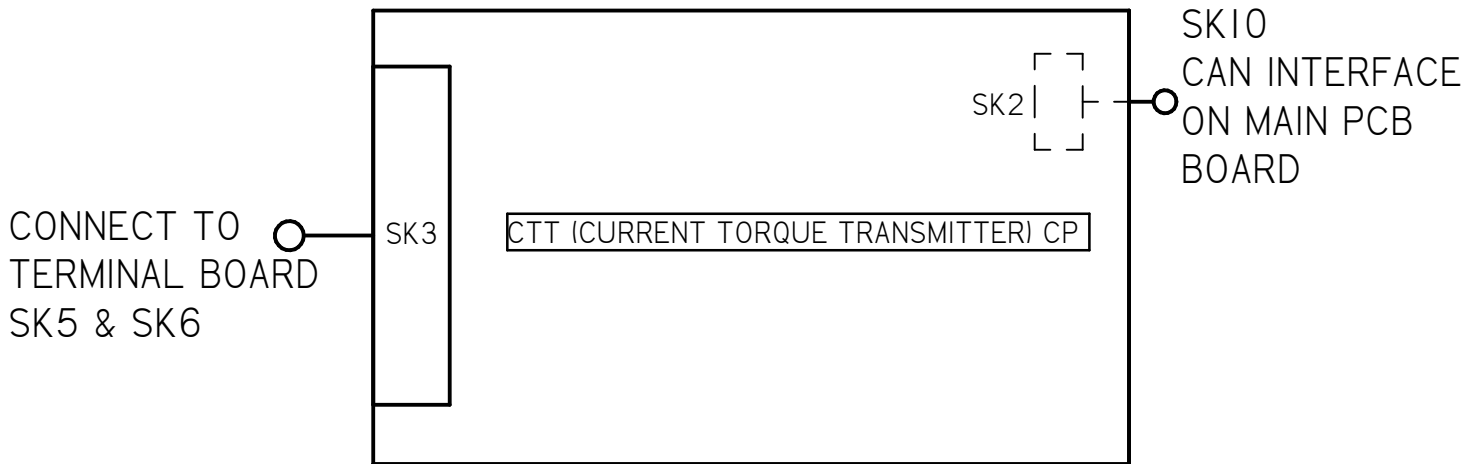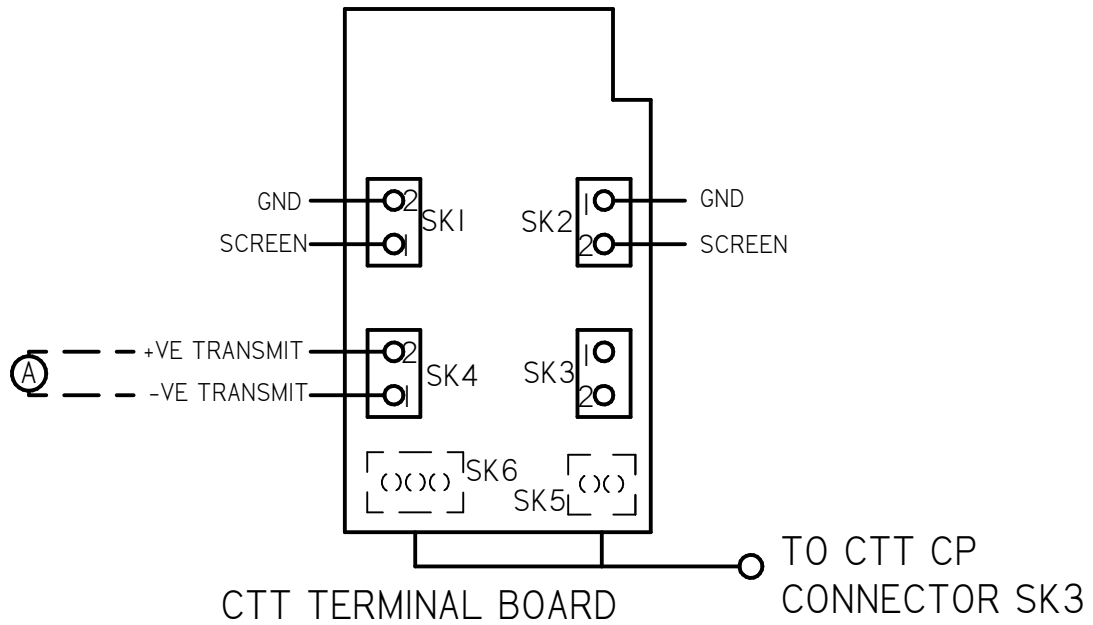

| | | |
|----------|-----------------|-----------------|
| | | |
| A | INITIAL RELEASE | GVM 12-29-17 |
| REV | DESCRIPTION | DATE |

| | | |
|---|-----------|------------|
| TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1° | | |
| SCALE: NTS | | |
| DRAWN: GVM | PROD. DV. | PROD. ENG. |
| DATE: 6/23/15 | DATE: | DATE: |


Process Controls
 MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

| | | |
|---|----------|---------------|
| TITLE : CMA WIRING DIAGRAM | | |
| FOR : AC POWER OPERATION LOCAL CONTROLS, CURRENT TORQUE TRANSMITTER TERMINAL CONNECTIONS | | |
| SHT 3 OF 3 | A | M02-20 |