

NOTES:


1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/D IF ATTACHED

SHT  
1 OF 3

**A**

M02-30

REV  
**A**

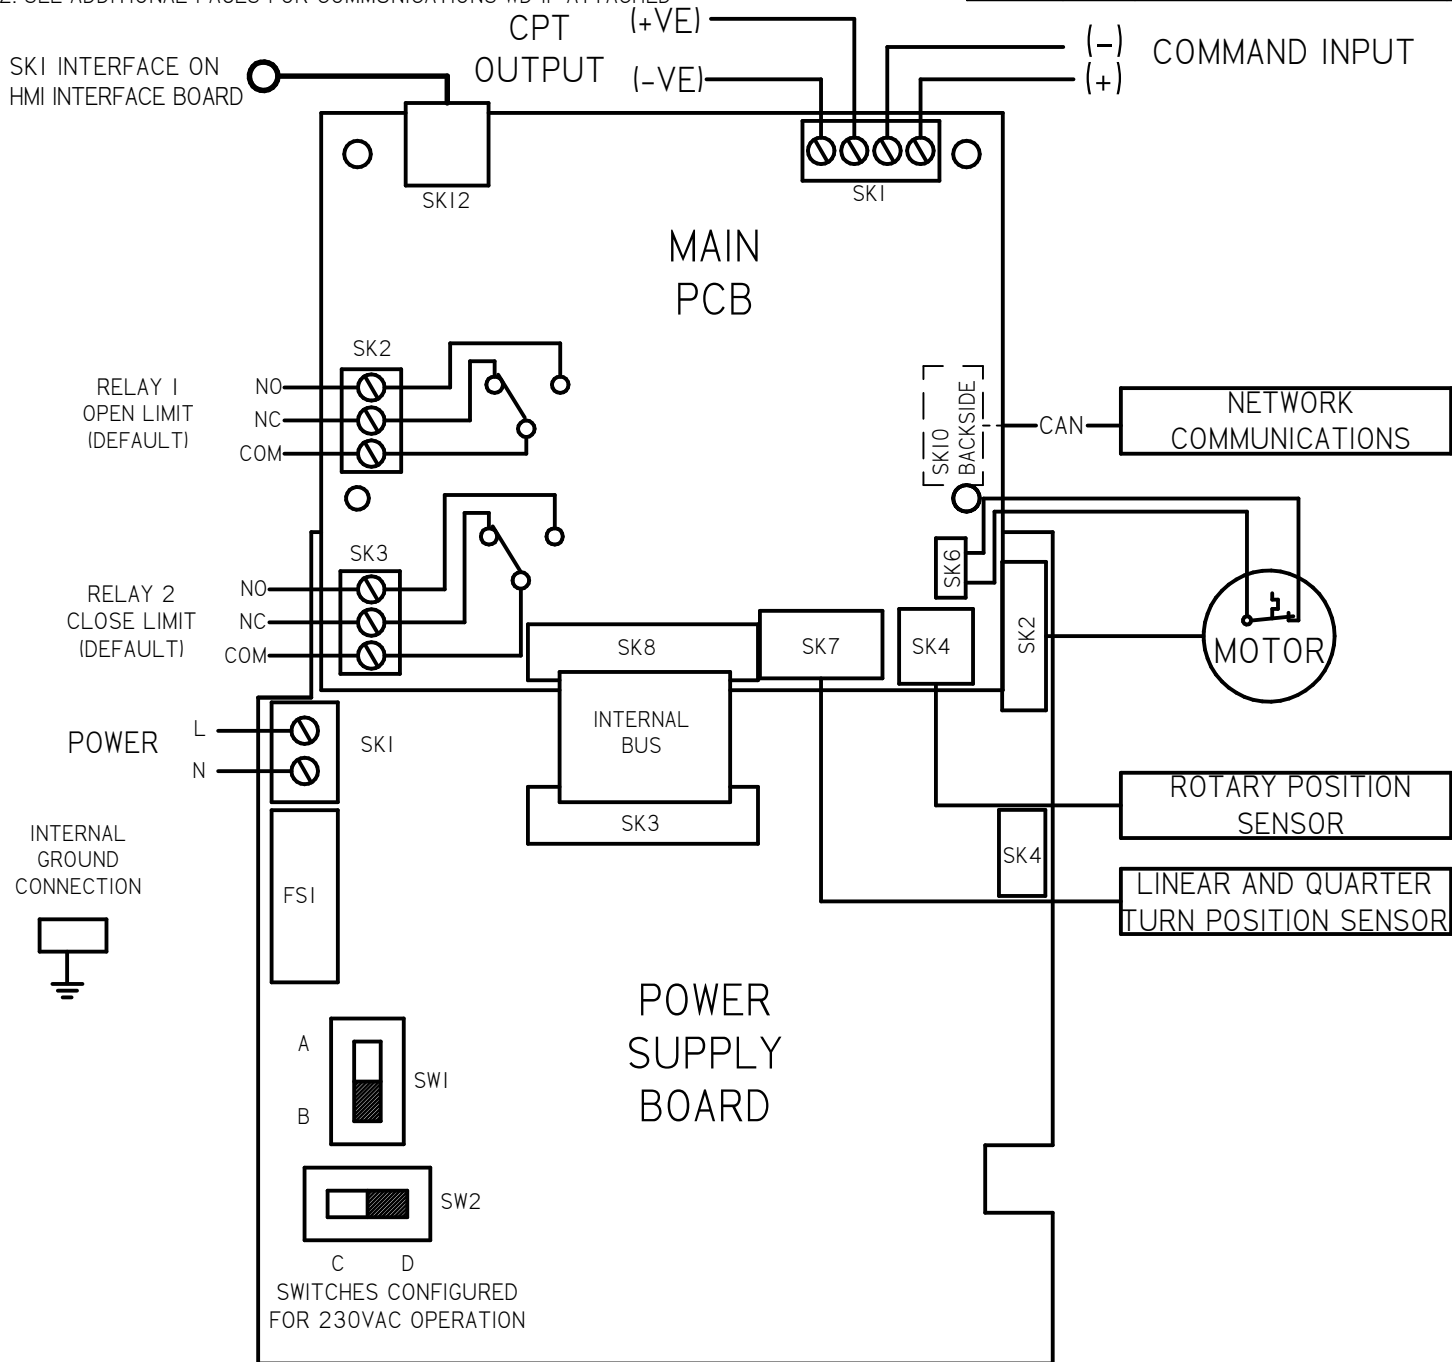

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D

REV	DESCRIPTION	DATE
A	INITIAL RELEASE	GVM 12-29-17

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: <b>GVM</b>	PROD. DV.	PROD. ENG.
DATE: <b>6/23/15</b>	DATE:	DATE:

**rotork**<sup>®</sup>  
**Process Controls**  
MILWAUKEE, WISCONSIN, USA


This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.



TITLE : <b>CMA WIRING DIAGRAM</b>		
FOR : AC POWER OPERATION, LOCAL CONTROLS, FOLO/CPT (CURRENT POSITION TRANSMITTER) TERMINAL CONNECTIONS		
SHT 1 OF 3	<b>A</b>	<b>M02-30</b>

# HMI INTERFACE BOARD



SKI2 INTERFACE ON  
MAIN PCB BOARD

A	INITIAL RELEASE	GVM	12-29-17		
REV	DESCRIPTION	DATE			
<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°			 MILWAUKEE, WISCONSIN, USA		TITLE : <b>CMA WIRING DIAGRAM</b>
SCALE: <b>NTS</b>					FOR : AC POWER OPERATION, LOCAL CONTROLS, FOLO/CPT (CURRENT POSITION TRANSMITTER) TERMINAL CONNECTIONS
DRAWN:	PROD. DV.	PROD. ENG.	This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.		SHT 2 OF 3
GVM					<b>A</b>
DATE:	DATE:	DATE:	<b>M02-30</b>		
6/23/15					

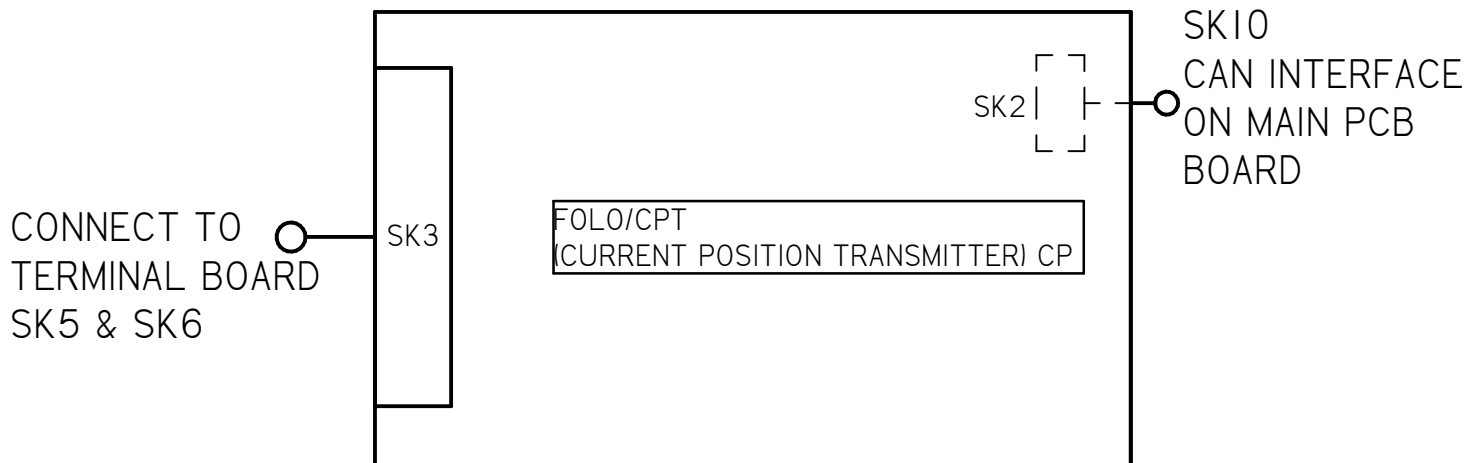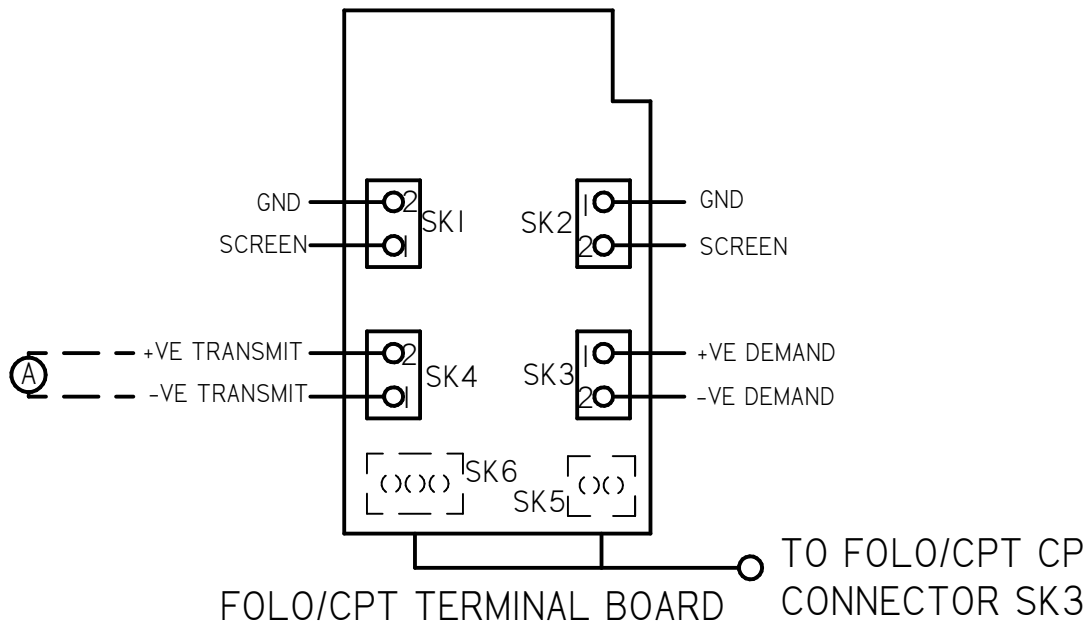

A	INITIAL RELEASE	GVM 12-29-17
REV	DESCRIPTION	DATE

<b>TOLERANCES</b> UNLESS OTHERWISE SPECIFIED .XX = ±.02    XXX = ±.005    ANGULAR ±1°		
SCALE: <b>NTS</b>		
DRAWN: <b>GVM</b>	PROD. DV.	PROD. ENG.
DATE: <b>6/23/15</b>	DATE:	DATE:

**rotork**<sup>®</sup>  
**Process Controls**  
 MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : <b>CMA WIRING DIAGRAM</b>		
FOR : AC POWER OPERATION, LOCAL CONTROLS, FOLO/CPT (CURRENT POSITION TRANSMITTER) TERMINAL CONNECTIONS		
SHT 3 OF 3	<b>A</b>	<b>M02-30</b>