

NOTES:
 1. 4-20 mA OUTPUT, 24VDC NOMINAL, (18-30 VDC MAX)
 2. SEE ADDITIONAL PAGES FOR COMMUNICATIONS W/ IF ATTACHED


SHT
1 OF 3

A

M02-70

REV
A

SKI INTERFACE ON HMI INTERFACE BOARD CPT (+VE) OUTPUT (-VE) (-) COMMAND INPUT (+)

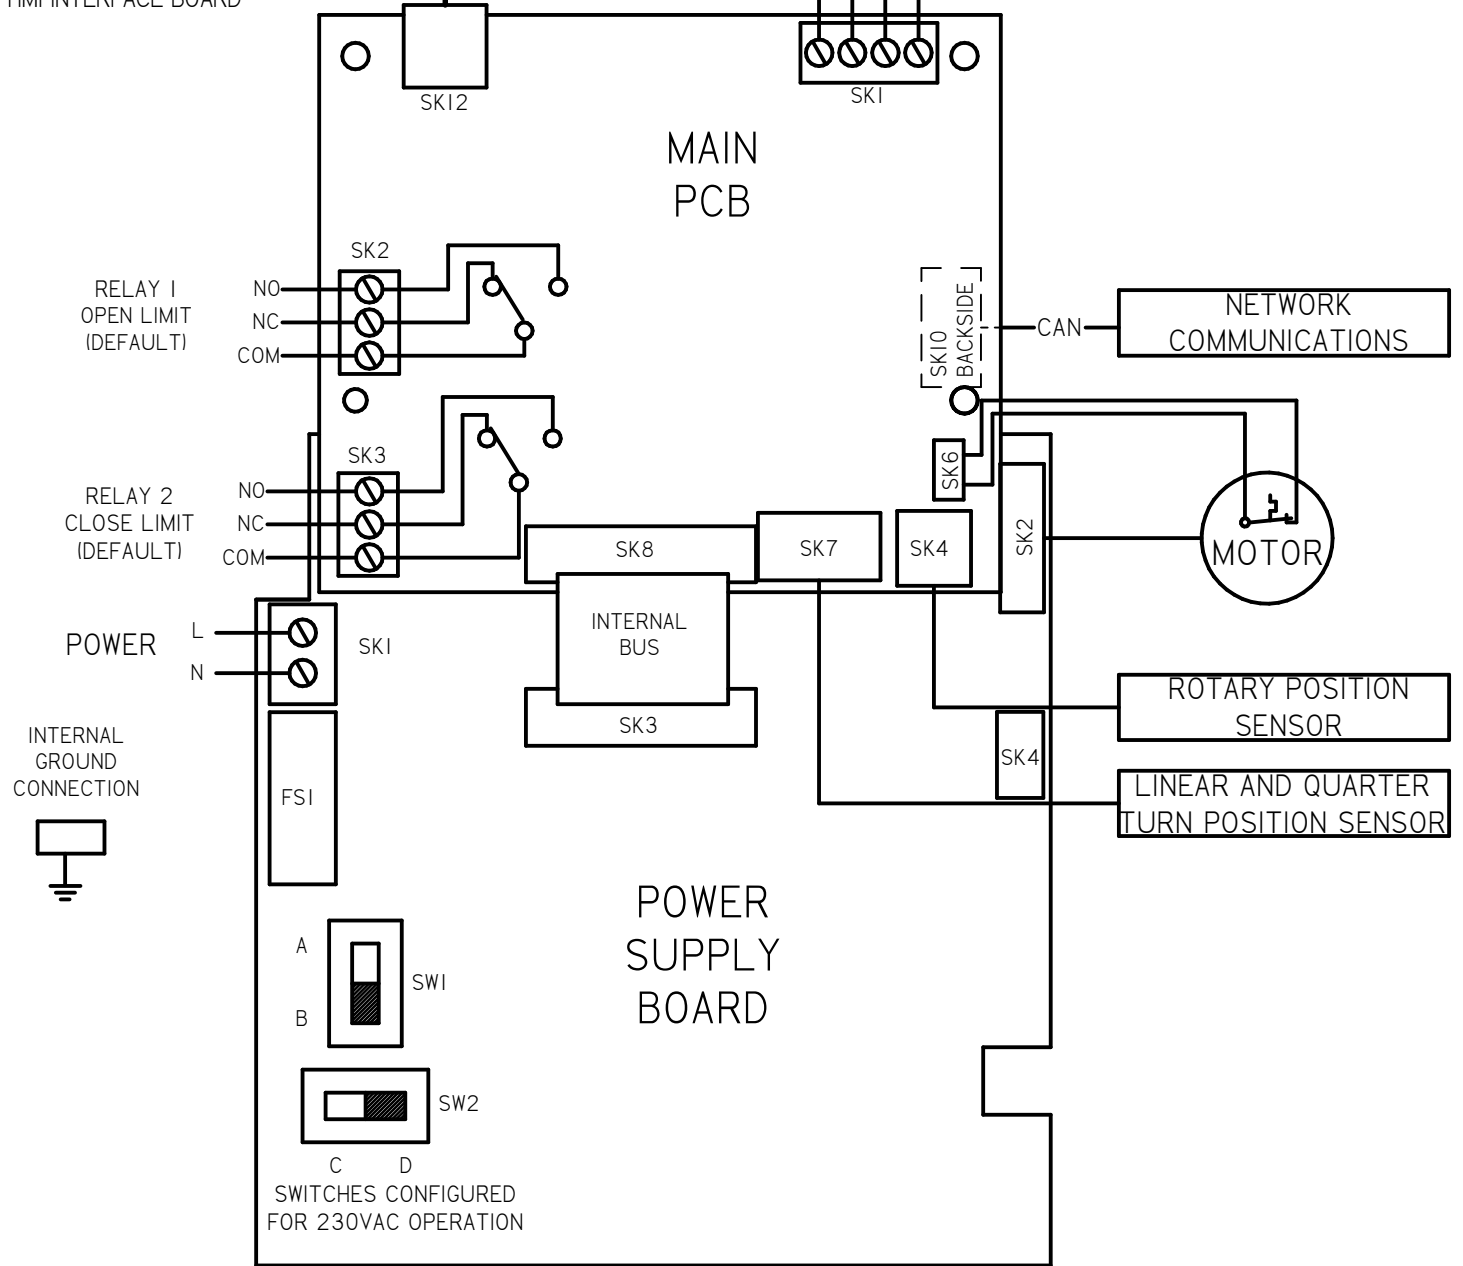

INPUT VOLTAGE	SW1	SW2
110 VAC	A	C
115 VAC	A	D
208 VAC	B	C
230 VAC	B	D

REV	DESCRIPTION	DATE
A	INITIAL RELEASE	GVM 12-29-17


TOLERANCES		
UNLESS OTHERWISE SPECIFIED		
.XX = ±.02 XXX = ±.005 ANGULAR ±1°		
SCALE: NTS		
DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 6/23/15	DATE:	DATE:

rotork
 Process Controls
 MILWAUKEE, WISCONSIN, USA


This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE :		
CMA WIRING DIAGRAM		
FOR : AC POWER OPERATION, LOCAL CONTROLS, FOLO/CPT (CURRENT POSITION TRANSMITTER) TERMINAL CONNECTIONS		
SHT 1 OF 3	A	M02-70



HMI INTERFACE BOARD

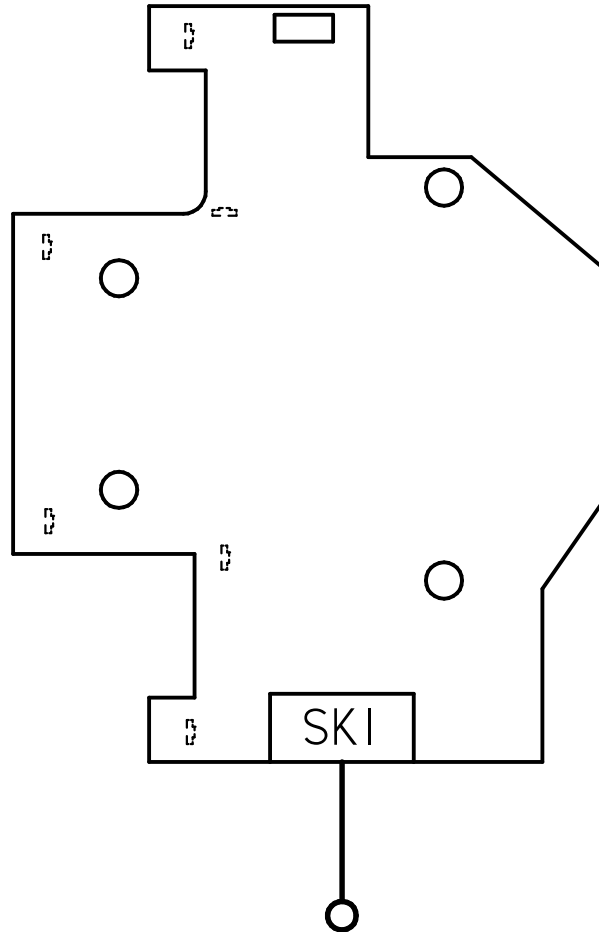

SKI2 INTERFACE ON
MAIN PCB BOARD

A	INITIAL RELEASE	GVM	12-29-17		
REV	DESCRIPTION	DATE			
TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°			 MILWAUKEE, WISCONSIN, USA		TITLE : CMA WIRING DIAGRAM
SCALE: NTS			FOR : AC POWER OPERATION, LOCAL CONTROLS, FOLO/CPT (CURRENT POSITION TRANSMITTER) TERMINAL CONNECTIONS		
DRAWN: GVM	PROD. DV.	PROD. ENG.	This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.		
DATE: 6/23/15	DATE:	DATE:	SHT 2 OF 3	A	M02-70

NOTE WHEN ACTUATOR
POWER IS LOST, OUTPUT
WILL GO TO LESS
THAN 1 mA

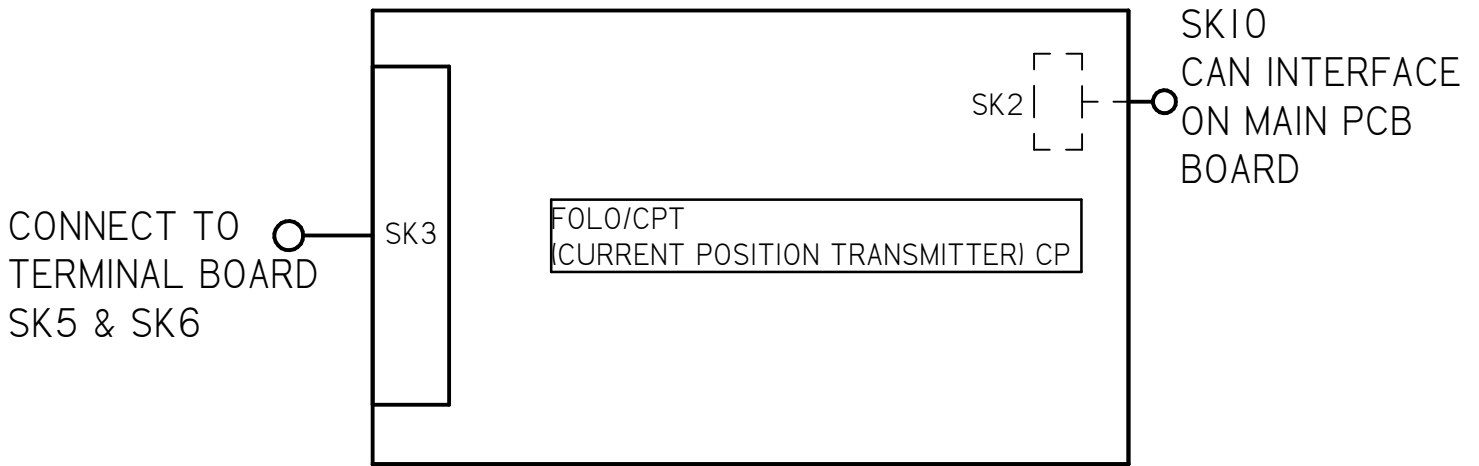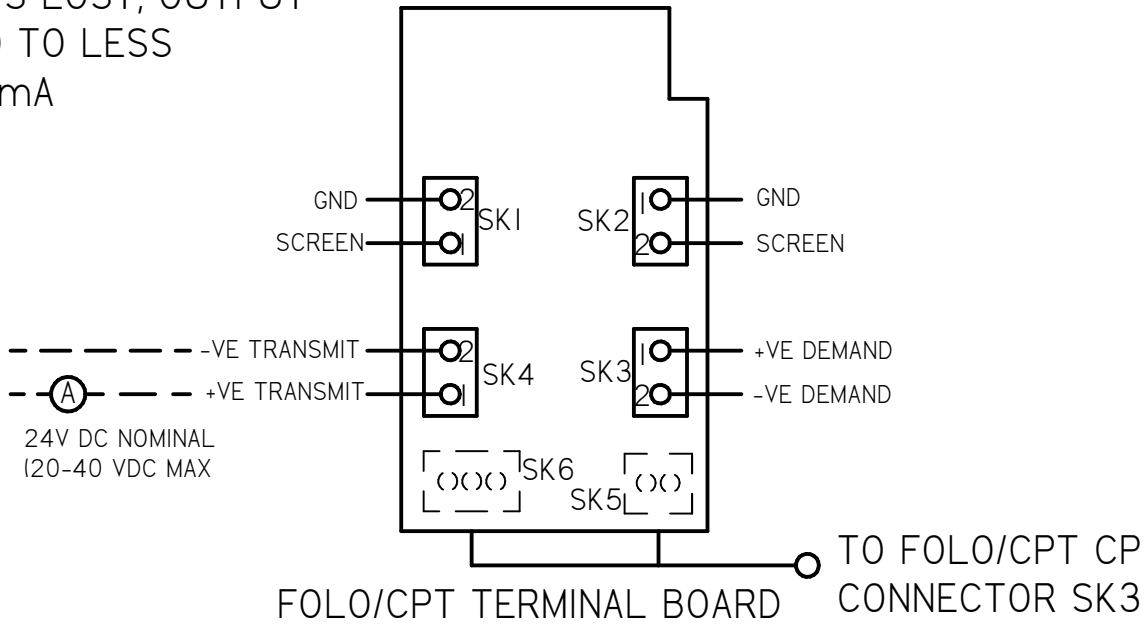

A	INITIAL RELEASE	GVM 12-29-17
REV	DESCRIPTION	DATE

TOLERANCES UNLESS OTHERWISE SPECIFIED .XX = ±.02 XXX = ±.005 ANGULAR ±1°		
SCALE: NTS		
DRAWN: GVM	PROD. DV.	PROD. ENG.
DATE: 6/23/15	DATE:	DATE:

rotork[®]
Process Controls
 MILWAUKEE, WISCONSIN, USA

This print is the property of Rotork Process Controls and is loaned in confidence subject to return. All rights to design or invention are reserved.

TITLE : CMA WIRING DIAGRAM		
FOR : AC POWER OPERATION, LOCAL CONTROLS, FOLO/CPT (CURRENT POSITION TRANSMITTER) TERMINAL CONNECTIONS		
SHT 3 OF 3	A	M02-70